

STRUCTURAL SOLUTIONS, P.A.

Structural Engineering ■ Investigations ■ Consulting

GARAGE DOOR EVALUATION REPORT

Garage Door No.:	IRC-1209-130-11-M	Model #	1200	Report Date:	6/17/2024
Design Pressures:	+26.7 psf, -31.6 psf	Test Pressures:	+40.1 psf, -47.4 psf		Project No. 17-075
Test Date:	5/11/2021	Test Location:	Amarr, 165 Carriage Ct., Winston-Salem, NC		
ASCE 7-22 Criteria:	Up to 5 Feet of Door Width in Zone 5; Any Roof Slope; Enclosed Building				
	Exp. B, 30' MRH	Exp. C, 15' MRH	Exp. C, 25' MRH	Exp. D, 15' MRH	Exp. D, 25' MRH
	168 mph	152 mph	145 mph	138 mph	133 mph

Reference Drawing and Test Report(s):

- Amarr Drawing number IRC-1209-130-11-M dated 09/01/2021
- Structural Solutions, P.A. report for IRC-1209-130-11-M dated 06/17/2024
 - Static Air Pressure Test witnessed by Thomas L. Shelmerdine, PE

Description of Test Specimen:

A 9'-0" wide x 7'-0" high x 2" thick sectional garage door, Model # 1200. All sections were made of 24 ga exterior / 27 ga interior galvanized steel sheet. The test unit is further described on Drawing IRC-1209-130-11-M.

Test Standards and Report Conclusions:

The above referenced Test Report states the following:

- The tests were conducted in accordance with ANSI/DASMA 108-17; ASTM E330-14
- The tests were witnessed and certified by: Thomas L. Shelmerdine, PE
- All tests passed the referenced Test Standards.
- The Amarr test facility is accredited by the American Association for Laboratory Accreditation, Cert. #2595.01.

Summary:

The 9'-0"x7'-0" Model # 1200 door as described on drawing IRC-1209-130-11-M meets or exceeds the testing criteria as described above. By comparison to the construction of the 9'-0"x7'-0" Model # 1200, the following doors also meet or exceed the above testing criteria, when constructed in accordance with drawing IRC-1209-130-11-M:

- 9' x 7' Model 1225 doors (which have a different paint pattern)
- 9' x 7' Amarr Heritage 3000 and Amarr Northwoods 3000 doors (which are alternate names for Models 1200 and 1225)
- Model 1200, Model 1225, Amarr Heritage 3000 and Amarr Northwoods 3000 doors with widths up to 9'-0" and heights up to 14'-0"
- Short, Long, and Bead Board Panels, which are alternate embossment patterns in the skin
- Up to 2 long-panel windows (38-1/8" x 10-5/8" x 3/32" SSB), or up to 4 short-panel windows (18-1/8" x 10-5/8" x 3/32" SSB), or up to 2 slimline windows (38" x 4" x 1/8" insulated Annealed glass) may be installed in any section or multiple sections.
- Windows are not required to be installed in any section.


To the best of my knowledge, the above garage door conforms to the requirements of the Florida Building Code 8th Edition (2023).

I certify that I have no financial interest in the testing lab(s) that performed the tests, nor in Amarr Garage Doors.

Submitted By:

Thomas L
Shelmerdine

Digitally signed by Thomas L
Shelmerdine
DN: c=US, o=North Carolina,
dnQualifier=A01410D0000018564
87A7B100125CE2, cn=Thomas L
Shelmerdine
Date: 2024.06.17 13:56:40 -04'00'

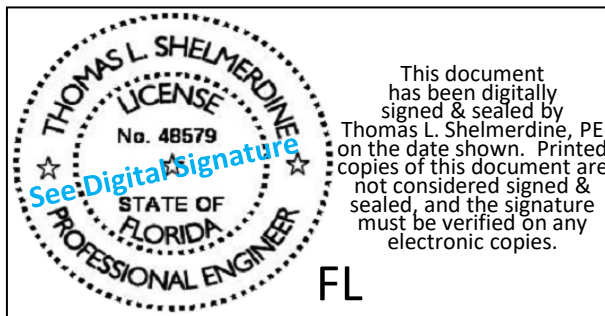

STRUCTURAL SOLUTIONS, P.A.

Thomas L. Shelmerdine, PE (Florida PE #0048579) (dba Structural Solutions of North Carolina, Inc., Florida Firm #29412)

5921-G West Friendly Avenue ■ Greensboro, North Carolina 27410 ■ (336) 856-2686 ■ www.sspa.biz ■ NC Firm #C-1096