

STRUCTURAL SOLUTIONS, P.A.

Structural Engineering ■ Investigations ■ Consulting

GARAGE DOOR EVALUATION REPORT

Garage Door No.:	IRC-9509-180-21-G		Model #	950	Report Date:	10/3/2023
Design Pressures:	+51.1 psf, -60.3 psf		Test Pressures:	+76.7 psf, -90.5 psf		Project No. 03-020
Test Date:	2/10-2/15/2022	Test Location:		American Test Lab, Inc., Brevard, NC		
ASCE 7-22 Criteria:	Up to 5 Feet of Door Width in Zone 5; Any Roof Slope; Enclosed Building					
	Exp. B, 30' MRH	Exp. C, 15' MRH	Exp. C, 25' MRH	Exp. D, 15' MRH	Exp. D, 25' MRH	
	232 mph	210 mph	200 mph	191 mph	183 mph	

Reference Drawing and Test Report(s):

- Amarr Drawing number IRC-9509-180-21-G dated 02/26/2022
- American Test Lab, Inc. report number ATLNC 0210.01-22 dated 04/06/2022
 - Tests witnessed and certified by David Johnson, PE (FL PE #61915) for:
 - Static Air Pressure Test • Large Missile Impact Test • Forced Entry Test • Cyclical Test • Tensile Test

Description of Test Specimen:

A 9'-0" wide x 7'-0" high x 2" thick sectional garage door, Model # 950. All sections were made of 24 ga galvanized steel sheet. The test unit is further described on Drawing IRC-9509-180-21-G.

Test Standards and Report Conclusions:

The above referenced Test Reports state the following:

- The tests were conducted in accordance with ANSI/DASMA 108-17; ASTM E330-14; FBC TAS 201 202 203; ASTM E8 E330-14a F588-07; ANSI/DASMA 108-17 115-17
- The tests were witnessed and certified by: David Johnson, PE (FL PE #61915)
- The weight of the missile used for the Large Missile Impact Test was 9.3 lbs.
- The maximum cycle time noted in the report is less than the maximum permitted based on the formula:
(area of specimen -75) x (F) + 3, where F= 0.06 for sectional doors.
- All tests passed the referenced Test Standards.
- The test facility at American Test Lab, Inc. is accredited by IAS, Certification #TL-423.

Summary:

The 9'-0"x7'-0" Model # 950 door as described on drawing IRC-9509-180-21-G meets or exceeds the testing criteria as described above. By comparison to the construction of the 9'-0"x7'-0" Model # 950, the following doors also meet or exceed the above testing criteria, when constructed in accordance with drawing IRC-9509-180-21-G:


- 9' x 7' Amarr Heritage 1000 doors (which is an alternate name for the Model 950)
- 9' x 7' Amarr Heritage 2000 doors (which is the Model 950 with drop-in insulation)
- Model 950 and Amarr Heritage 1000 & 2000 doors with widths of up to 9' and heights of up to 14'.
- Up to 4 short panel windows (5/16" x 18-1/8" x 10-5/8" annealed laminated glass with .090" PVB interlayer - meets ASTM E1300-04) may be installed in 1 section.
- Windows are not required to be installed in any section.

To the best of my knowledge, the above garage door conforms to the requirements of the Florida Building Code 8th Edition (2023). I certify that I have no financial interest in the testing lab(s) that performed the tests, nor in Amarr Garage Doors.

Submitted By:

Thomas L
Shelmerdine

Digitally signed by Thomas L
Shelmerdine
DN: c=US, o=North Carolina,
dnQualifier=A01410D000001856487A7B
100125CE2, cn=Thomas L Shelmerdine
Date: 2023.10.03 12:58:23 -04'00'

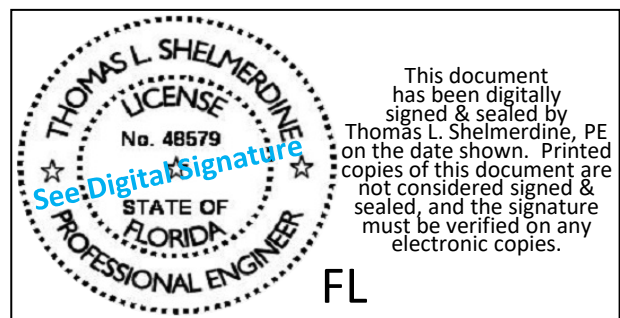

STRUCTURAL SOLUTIONS, P.A.

Thomas L. Shelmerdine, PE (Florida PE #0048579) (dba Structural Solutions of North Carolina, Inc., Florida Firm #29412)

5921-G West Friendly Avenue ■ Greensboro, North Carolina 27410 ■ (336) 856-2686 ■ www.sspa.biz ■ NC Firm #C-1096