

**EVALUATION REPORT OF  
ALLIANCE STEEL INC.'S  
'ALLIANCE SEAM 24 PANELS'**


**FLORIDA BUILDING CODE 9TH EDITION (2026)  
FLORIDA PRODUCT APPROVAL  
FL 41984.2-R2  
STRUCTURAL COMPONENTS  
ROOF DECK**

**Prepared For:  
Alliance Steel, Inc.  
3333 South Council Road  
Oklahoma City, OK 73179-4410  
Telephone: (405) 745 7500**

**Prepared By:  
Bala Sockalingam, Ph.D., P.E.  
Florida Professional Engineer #62240  
1216 N Lansing Ave., Suite C  
Tulsa, OK 74106  
Telephone: (918) 492-5992**

**This report consists of  
Evaluation Report (3 Pages including cover)  
Installation Details (2 Pages)  
Load Span Tables (2 Pages)**

**Report No. C3087-2  
Date: 10.15.2026**

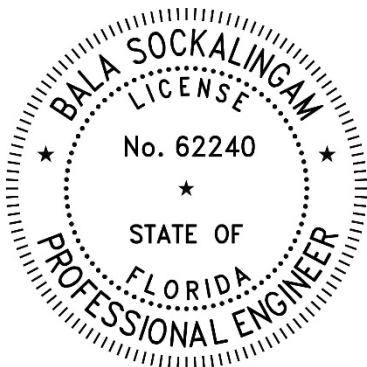

This item has been digitally signed and sealed by Bala Sockalingam, PE, on the date indicated.

Printed copies of this document are not considered signed and sealed and this signature must be verified on any electronic copies.

**2026.10.15  
15:31:19  
-04'00'**


|                         |                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                           |
|-------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| Manufacturer:           | Alliance Steel Inc.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                       |
| Product Name:           | Alliance Seam 24                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                          |
| Panel Description:      | Standing seam panel with 24" wide coverage and 3" high ribs                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                               |
| Materials:              | Min 24 or 22 ga. with galvalume coated steel (ASTM A792) or painted steel (ASTM A755) ( $F_y = 50$ ksi). Corrosion resistant as per FBC 2026 Section 1507.4.3.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |
| Support Description:    | Min 16 ga., 50 ksi steel section (Must be designed by others)                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                             |
| Slope:                  | 1/4:12 or greater in accordance with FBC 2026 Section 1507.4.2                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                            |
| Design Uplift Pressure: | <p>Allowable uplift loads are shown in the load span tables for 24 and 22 ga. panels with RollLok, TripleLok and Quadlok Seams fastened with MPS 600, FC 600 or BA Series clips. Maximum panel span is 5'.</p> <p>The allowable uplift loads were determined from ASTM E1592 testing and are applicable for the panel and panel to clip connection. Clip fastener, purlin, frames and support connections must be designed to resist all loads. The factors of safety were determined in accordance with FBC 2026 Section 1504.9, ASTM E1592 test standard and the procedures of Section I6.3.1, K2.1.1 and K2.1.2 of the AISI S100-16(2020) w/S2-20.</p> |
| Panel Attachment:       | MPS 600, FC 600 or BA Series clips with minimum (2) 1/4"-14 x 1-1/2" SDS per clip at each support. Clips and fasteners are corrosion resistant as per FBC 2026 Section 1506.7 and 1507.4.4, respectively. For installation in areas within 3000 ft. of a saltwater coastline, clips and fasteners are corrosion resistant as per FBC 2026 Section 1711.                                                                                                                                                                                                                                                                                                   |
| Test Standards:         | Roof assembly tested in accordance with ASTM E1592-98 or E1592-01 'Test Method for Structural Performance of Sheet Metal Roof and Siding Systems by Uniform Static Air Pressure Difference' and FM 4470 Section 5.5 'Resistance to Foot Traffic'.                                                                                                                                                                                                                                                                                                                                                                                                         |
| Test Equivalency:       | <p>The test procedures in ASTM E1592-98 or E1592-01 comply with test procedures prescribed in ASTM E1592-05(2017).</p> <p>The test procedures in FM 4470 (1992) comply with test procedure prescribed in FM 4470 (2022) Section 4.6 'Resistance to Foot Traffic'.</p>                                                                                                                                                                                                                                                                                                                                                                                     |
| Code Compliance:        | The product described herein has demonstrated compliance with FBC 2026 Section 1507.4.                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                                    |

**Product Limitations:** Design wind loads shall be determined for each project in accordance with FBC 2026 Section 1609 or ASCE 7-22 using allowable stress design. The maximum panel span listed herein shall not be exceeded. The design uplift pressure for reduced panel span may be computed using rational analysis prepared by a Florida Professional Engineer or based on Alliance Steel's load span tables. This evaluation report is not applicable in High Velocity Hurricane Zone. Fire classification is not within scope of this Evaluation Report. Refer to FBC 2026 Section 1505 and current approved roofing materials directory or ASTM E108/UL790 report from an accredited laboratory for fire ratings of this product.


**Supporting Documents:** ASTM E1592 Test Reports  
Project No. C596, Reporting Date 10/28/1998  
Project No. C739, Reporting Date 7/28/1999  
Project No. C1417-1, Reporting Date 1/20/2006  
Project No. C1417-2, Reporting Date 1/23/2006  
Project No. C1417-4, Reporting Date 1/25/2006  
Project No. C1672-1, -2 & -3, Reporting Date 4/12/2002, Revised Date 9/29/2009  
Project No. C1950-1, Reporting Date 3/26/2014  
Project No. C2344-1, Reporting Date 6/12/2023

FM 4470 Test Report  
ENCON Technology Inc.  
C1669-1, Reporting Date 9/30/2009




(Alliance Steel is authorized to use Building Research System's Test Reports)

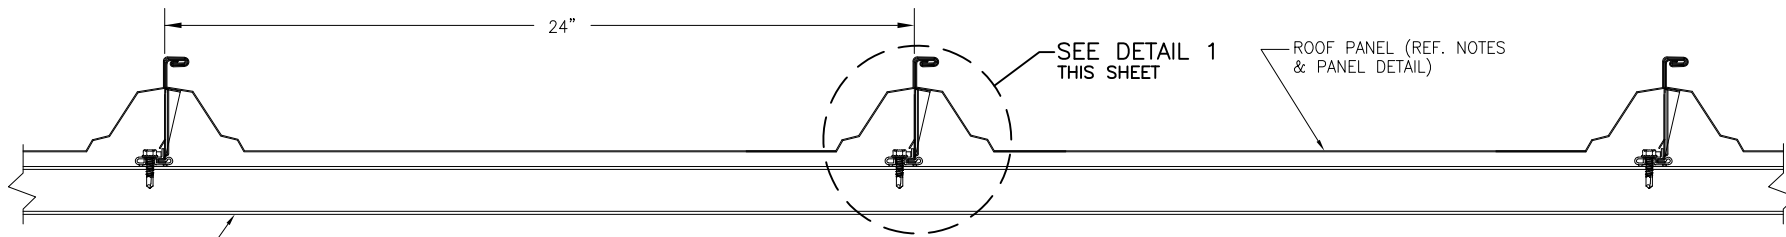


**TYPICAL PANEL INSTALLATION X-SECTION**

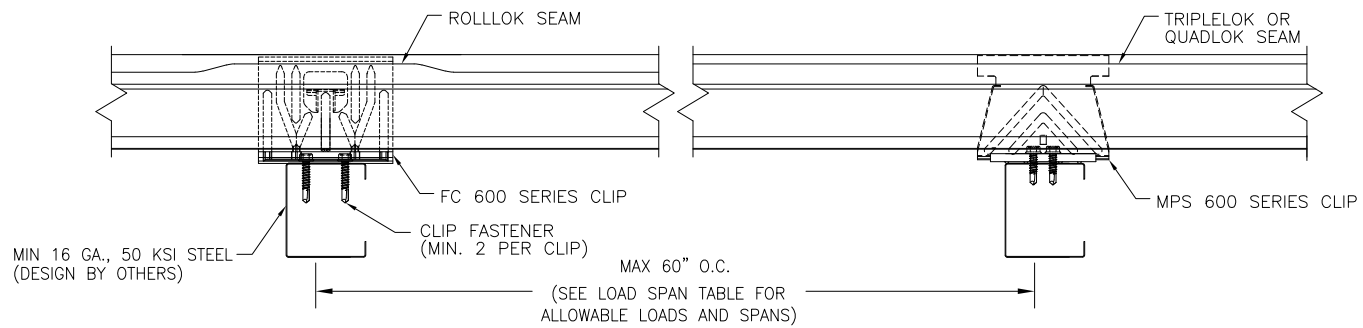

**TYPICAL SIDE VIEW**

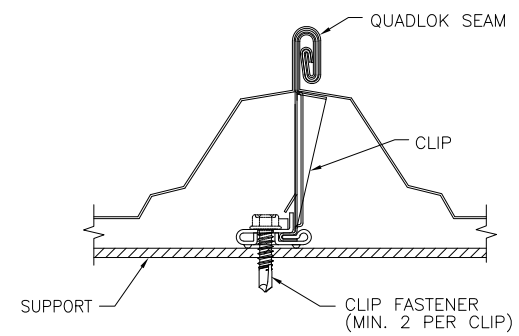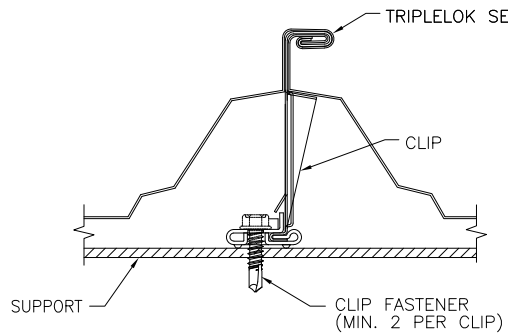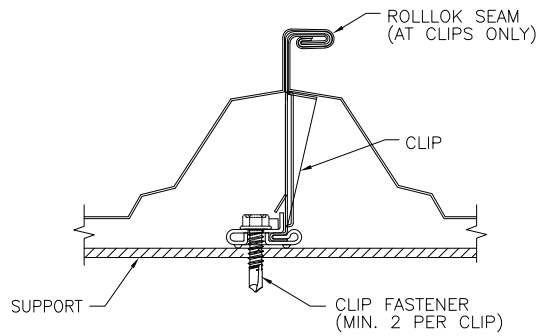

**CLIP SECTION VIEW  
DETAIL 1**

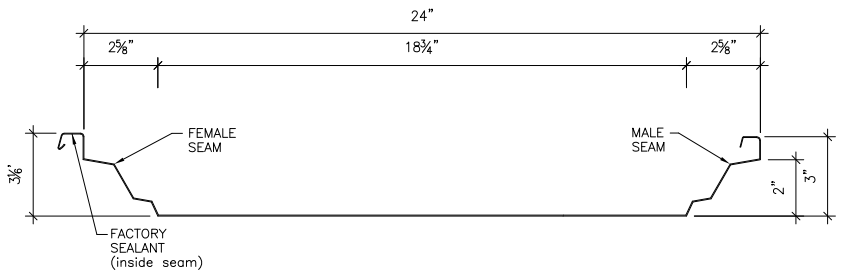


**PANEL SECTION  
(MIN 24 GA.)**

**GENERAL NOTES:**


1. STRUCTURAL ROOF PANEL HAS BEEN DESIGNED IN ACCORDANCE WITH THE FLORIDA BUILDING CODE (FBC).
2. ROOF PANELS SHALL BE 24 GA. (t = 0.022") OR 22 GA. (t = 0.0285"). EFFECTIVE COVERING WIDTH OF PANEL = 24".
3. ROOF PANELS SHALL BE INSTALLED OVER STRUCTURE AS SPECIFIED ON THESE DRAWINGS.
4. REQUIRED DESIGN WIND LOADS SHALL BE DETERMINED FOR EACH PROJECT. THIS PANEL SYSTEM MAY NOT BE INSTALLED WHEN THE REQUIRED DESIGN WIND LOADS ARE GREATER THAN THE ALLOWABLE DESIGN LOADS.
5. CLIPS AND FASTENERS MUST BE IN ACCORDANCE WITH THESE DRAWINGS & FLORIDA BUILDING CODE. IF A DIFFERENCE OCCURS BETWEEN THE MINIMUM REQUIREMENTS OF THESE DRAWINGS & THE CODE, THE CODE SHALL CONTROL.
6. SUPPORTS MUST BE DESIGNED TO WITHSTAND WIND LOADS AS REQUIRED FOR EACH APPLICATION AND ARE THE RESPONSIBILITY OF OTHERS.

|                                                                                          |      |                                                                         |                      |
|------------------------------------------------------------------------------------------|------|-------------------------------------------------------------------------|----------------------|
| DRAWN BY:<br>B.S.                                                                        |      | CHECKED BY:<br>K.S.                                                     |                      |
| PLOT:                                                                                    |      | DATE:<br>8/24/2023                                                      |                      |
| NO.                                                                                      | DATE | BY                                                                      | REVISION DESCRIPTION |
|                                                                                          |      |                                                                         |                      |
| DRAWING TITLE<br><b>ALLIANCE SEAM 24 PANEL</b>                                           |      |                                                                         |                      |
| CONSULTANTS<br><b>BALA SOCKALINGAM, PH.D., P.E.</b>                                      |      | MANUFACTURER<br><b>ALLIANCE STEEL INC.</b>                              |                      |
| 1216 N. LANSING AVE. SUITE C<br>TULSA, OK 74106<br>PHONE: 918-492-9992 FAX: 866-366-1543 |      | 3333 SOUTH COUNCIL ROAD<br>OKLAHOMA CITY, OK 73179-4410<br>405 745 7500 |                      |
| DRAWING NO.<br><b>2682-2</b>                                                             |      | REV.<br>                                                                |                      |
| PAGE NO.<br><b>1</b>                                                                     |      | OF<br><b>2</b>                                                          |                      |

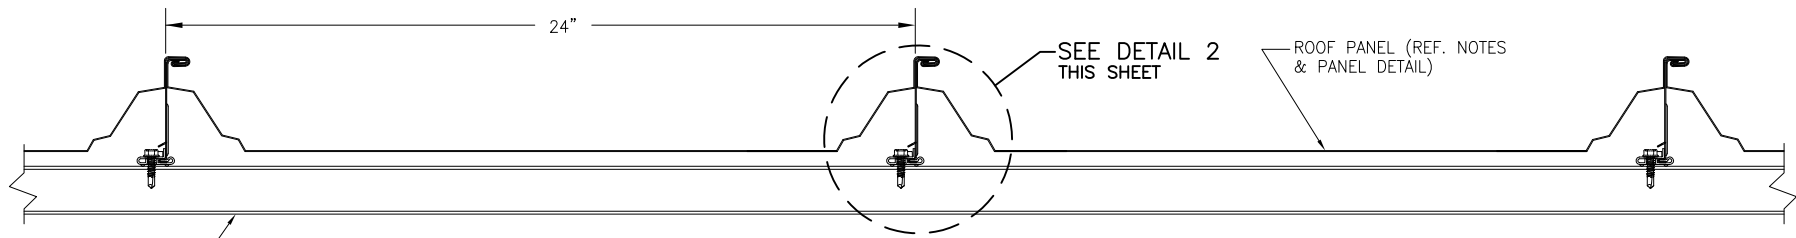

MIN 16 GA., 50 KSI STEEL  
(DESIGN BY OTHERS)

TYPICAL PANEL INSTALLATION X-SECTION

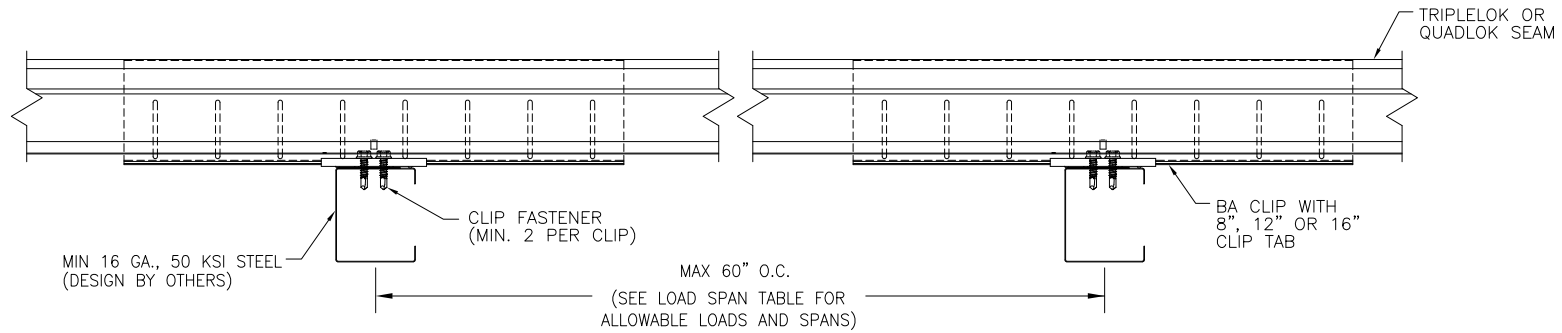

MIN 16 GA., 50 KSI STEEL  
(DESIGN BY OTHERS)

CLIP FASTENER  
(MIN. 2 PER CLIP)


MAX 60" O.C.

(SEE LOAD SPAN TABLE FOR  
ALLOWABLE LOADS AND SPANS)

BA CLIP WITH  
8", 12" OR 16"  
CLIP TAB

TRIPLELOK OR  
QUADLOK SEAM

TYPICAL SIDE VIEW

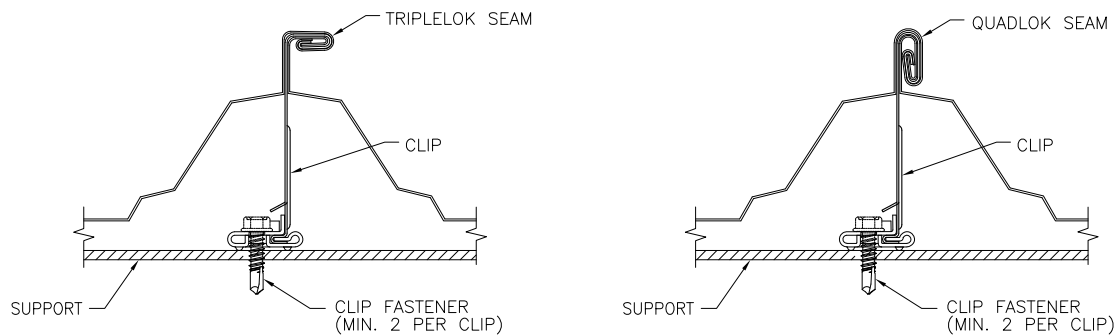

CLIP FASTENER  
(MIN. 2 PER CLIP)

SUPPORT

CLIP FASTENER  
(MIN. 2 PER CLIP)

CLIP SECTION VIEW  
DETAIL 2

|                               |                              |
|-------------------------------|------------------------------|
| DRAWN BY:<br>B.S.             | CHECKED BY:<br>K.S.          |
| PLOT:                         | DATE:<br>8/24/2023           |
| NO.                           | DATE                         |
| BY                            | BY                           |
| REVISION DESCRIPTION          | REVISION DESCRIPTION         |
| NO.                           | DATE                         |
| DRAWING TITLE                 |                              |
| ALLIANCE SEAM 24 PANEL        |                              |
| CONSULTANTS                   | MANUFACTURER                 |
| BALA SOCKALINGAM, PH.D., P.E. | ALLIANCE STEEL INC.          |
| 1216 N. LANSING AVE. SUITE C  | 3333 SOUTH COUNCIL ROAD      |
| TULSA, OK 74110               | OKLAHOMA CITY, OK 73179-4410 |
| PHONE: 918-492-5992           | 405 745 7500                 |
| DRAWING NO.                   | REV.                         |
| 3087-2                        |                              |
| PAGE NO.                      | OF                           |
| 2                             | 2                            |

**ALLIANCE STEEL INC.**  
**Alliance Seam 24 Panel Uplift Loads**  
**With MPS or FC 600 Series Clips**

| Seam      | Span<br>(ft) | Allowable Uplift Load (psf) |        |
|-----------|--------------|-----------------------------|--------|
|           |              | 24 ga.                      | 22 ga. |
| RollLok   | 2            | 61.1                        |        |
|           | 2.5          | 55.6                        | 57.2   |
|           | 3            | 47.2                        | 52.5   |
|           | 3.5          | 40.4                        | 47.8   |
|           | 4            | 35.4                        | 42.3   |
|           | 4.5          | 31.4                        | 37.6   |
|           | 5            | 28.3                        | 33.8   |
| TripleLok | 2            | 85.5                        | 122.5  |
|           | 2.5          | 78.4                        | 98.0   |
|           | 3            | 71.3                        | 81.7   |
|           | 3.5          | 61.1                        | 70.0   |
|           | 4            | 53.5                        | 61.3   |
|           | 4.5          | 47.6                        | 54.4   |
|           | 5            | 42.8                        | 44.0   |
| QuadLok   | 2            | 108.8                       | 157.5  |
|           | 2.5          | 99.7                        | 126.0  |
|           | 3            | 89.8                        | 105.0  |
|           | 3.5          | 77.0                        | 90.0   |
|           | 4            | 67.4                        | 78.8   |
|           | 4.5          | 59.9                        | 70.0   |
|           | 5            | 53.9                        | 56.0   |

**Notes:**

1. The allowable uplift loads were determined from ASTM E1592 testing and are applicable for the panel and panel to clip connection. Clip fastener, purlin, frames and support connections must be designed to resist all loads imposed on the panel.
2. The factor of safety was determined in accordance with the procedures of Section I6.3.1, K2.1.1 and K2.1.2 of the AISI S100-16(2020) w/S2-20.
3. The factor of safety for 24 ga. Alliance Seam 24 panels varied between 1.702 and 1.715.
4. The factor of safety for 22 ga. Alliance Seam 24 panels was 2.0.
5. Panels must be installed as per Evaluation Report FL 41984.2 and Alliance Steel's current installation procedure.
6. MPS 600 Series Clip: MPS 602, 603, 607, 608, 609. FC 600 Series Clip: FC 602, 603, 607, 608, 609.
7. Three or more spans condition.

**ALLIANCE STEEL INC.**  
**Alliance Seam 24 Panel Uplift Loads**  
**With BA Series Clips**

| Seam      | Span<br>(ft) | Allowable Uplift Load (psf) |                           |                           |
|-----------|--------------|-----------------------------|---------------------------|---------------------------|
|           |              | BA-602-8 or<br>BA-603-8     | BA-602-12 or<br>BA-603-12 | BA-602-16 or<br>BA-603-16 |
| TripleLok | 2            | 106.0                       | 127.8                     | 149.7                     |
|           | 2.5          | 97.0                        | 116.8                     | 136.6                     |
|           | 3            | 86.4                        | 102.6                     | 118.7                     |
|           | 3.5          | 74.1                        | 87.9                      | 101.7                     |
|           | 4            | 64.8                        | 76.9                      | 89.0                      |
|           | 4.5          | 57.6                        | 68.4                      | 79.1                      |
|           | 5            | 51.9                        | 61.5                      | 71.2                      |
| QuadLok   | 2            | 144.8                       | 183.3                     |                           |
|           | 2.5          | 132.2                       | 166.8                     |                           |
|           | 3            | 114.4                       | 140.7                     |                           |
|           | 3.5          | 98.1                        | 120.6                     |                           |
|           | 4            | 85.8                        | 105.5                     |                           |
|           | 4.5          | 76.3                        | 93.8                      |                           |
|           | 5            | 68.7                        | 84.4                      |                           |

**Notes:**

1. The allowable uplift loads were determined from ASTM E1592 testing and are applicable for the panel and panel to clip connection. Clip fastener, purlin, frames and support connections must be designed to resist all loads imposed on the panel.
2. The factor of safety was determined in accordance with the procedures of Section I6.3.1, K2.1.1 and K2.1.2 of the AISI S100-16(2020) w/S2-20.
3. The factor of safety for 24 ga. Alliance Seam 24 panels varied between 1.702 and 1.709.
4. Panels must be installed as per Evaluation Report FL 41984.2 and Alliance Steel's current installation procedure.
5. The clip tab width for the following clips are as follows:  
BA-602-8 or BA-603-8: 8"  
BA-602-12 or BA-603-12: 12"  
BA-602-16 or BA-603-16: 16"
6. Three or more spans condition.