



WALTER A. TILLIT, JR., P.E.

PRODUCT EVALUATION REPORT

tilteco@aol.com
FL P.E. License No. 44167
FL C.A. License No. 0006719

REPORT NO.: 26-0812.01
DATE: August 12 2026
PRODUCT CATEGORY: Panel Walls
PRODUCT SUB-CATEGORY: Siding
PRODUCT NAME: CWS 6" Decorative Exterior Wall Panel Systems
MANUFACTURER: CHAMCLAD BY CHAMELEON
12810 – 170 ST, N.W
EDMONTON, AB T5V 0A6
Canada

1. PURPOSE OF EVALUATION:

This is a Product Evaluation Report issued by **Walter A. Tillit, Jr., P.E.** (System ID # 1906) to **CHAMCLAD BY CHAMELEON**, based on Rule Chapter No. 61G20-3, Method 1D of the Florida Department of Business and Professional Regulation.


This product is being issued an Evaluation Report as described herein, and has been verified for compliance in accordance with the 2026 9th edition of the Florida Building Code, and to verify that the product is for the purpose intended at least equivalent to that required by the Code.

This Product Evaluation Report shall be subject to review and revision in case of a Building Code Change that may affect its limitations and conditions.

2. EVIDENCE SUBMITTED:

2.1. PRODUCT EVALUATION DOCUMENT (P.E.D.):

Drawing No. **26-263** Titled "CWS 6" Decorative Exterior Wall Panel Systems" sheets 1 thru 26 (Includes 5A, 6A, 8A, 9A, 13A, 14A, 16A, 17A, 21A, 22A, 24A & 25A) prepared by Tilteco, Inc.; signed and sealed by Walter A. Tillit, Jr., P.E. dated 8/12/2026. This drawing is an integral part of this Evaluation Report.

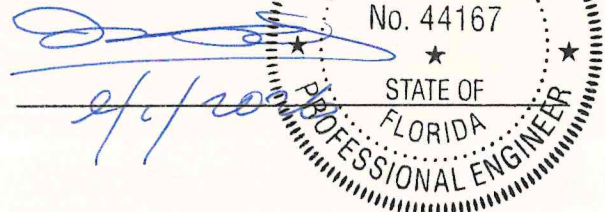

2.2. TEST REPORTS:

Uniform static wind and cyclic loads per Protocol TAS 202 and 203, per sections 1626 and 1609.1.2 of the Florida Building Code. Uniform static loads as per Protocol TAS 202.

Test reports prepared by Element Lab, report No. ESP039708P, dated 10/07/2023 and ESP041447P, dated 2/27/2024, signed and sealed by Mr. Jason Steen, P.E.

Fire burning characteristics per ASTM D2843 & 0635, Tests prepared by Element Laboratories Report #23-06-P0002 dated 08/31/2023,

Weathering Testing on Modulus of ELASTICITY per ASTM G-155 and ASTM D638, per Element Report #23-06-P0002, dated 08/31/2023.

2.3. STRUCTURAL ENGINEERING CALCULATIONS:

On CWS 6" Decorative Exterior Wall Panel Systems for maximum anchor spacing at furring vs. design wind load and substrate type based on rational and comparative analysis, and in accordance with sections 1604 and 1616 of the Florida Building Code. Calculations prepared by Tilteco, Inc., dated 11/21/2023 & 3/4/2024, signed and sealed by Walter A. Tillit, Jr., P.E.

3. MISSILE IMPACT RESISTANCE:

Not applicable. See P.E.D. Drawing # 26-263, note 2, sheet 1 for limitations.

4. WIND LOADS RESISTANCE:

CWS 6" Decorative Exterior Wall Panel Systems has been verified to sustain wind pressures. Maximum spacing between furring shall be as indicated on sheet 18, schedule # 2 of Product Evaluation Document (P.E.D.), drawing No 26-263 Maximum Anchor Spacing for connection of furring 7 or 7A to applicable substrates shall be as indicated on sheet 26, Schedule #1, of Product Evaluation Document (P.E.D.), drawing No 26-263.


5. INSTALLATION:

Installation shall be performed strictly in accordance with details indicated on sheets 4 thru 9A, 12 thru 17A and 20 thru 25A, of Product Evaluation Document (P.E.D.), drawing No. 26-263.

6. MATERIAL CHARACTERISTICS AND SPECIFICATIONS:

Shall be strictly in accordance with General Notes and Components indicated on sheets 2, 3, 10, 11, 18 and 19 of Product Evaluation Document (P.E.D.), drawing No 26-263.

Anchor specifications for furring 7 or 7A anchorage shall be as indicated on Schedule # 1, sheet 26, of Product Evaluation Document (P.E.D.), drawing No 26-263

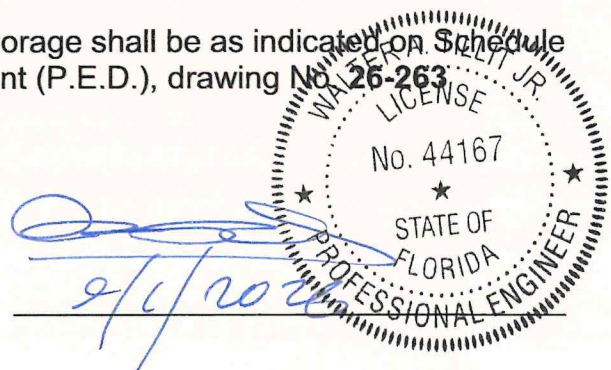

7. LIMITATIONS AND CONDITIONS OF USE:

7.1. Shall be strictly in compliance with General Notes No. 1 thru 9, indicated on sheet 1 of Product Evaluation Document (P.E.D.), drawing No. **26-263** prepared by Tilteco, Inc. and signed and sealed by Walter A. Tillit, Jr., P.E.

7.2. Product may be installed within HIGH VELOCITY HURRICANE ZONES as defined on section 202 of the Florida Building Code and out of it.

7.3. Product shall only be installed into poured concrete, concrete block wall and wood structures with limitations indicated on sheet 26 of Product Evaluation Document (P.E.D.), drawing No. **26-263**

7.4 Rate of Burring Limited to CC-1 Class fire burning characteristic

Product Evaluation Report prepared by Walter A. Tillit, Jr., P.E. (Florida License No. 44167), President of Tilteco, Inc. (Florida CA-0006719).

The image shows a handwritten signature in blue ink, which appears to be "WAT", followed by the date "9/1/2016". To the right of the signature is a circular professional engineer seal for the State of Florida. The seal contains the text "WALTER A. TILLIT JR.", "LICENSE", "No. 44167", "STATE OF FLORIDA", and "PROFESSIONAL ENGINEER".

WAT/m#

D:\ TILTECO ADMN RECORDS \ PRODUCT EVALUATION REPORT 26 \ CHAMCLAD BY CHAMELEON / CWS 6"
DECORATIVE EXTERIOR WALL PANEL SYSTEMS / DRWG # 26-263 / REPORT 26-0812.01