

Micah Swartz, P.E.

Project Number: MS24-09003

Project Name: LaCantina V2 Aluminum 2 Panel (ISW)

Date: 9/8/2025

Page: 1 of 8

**Product Approval Supporting Calculations
Alternative Anchorage Analysis & Design
R1 - Admin Update**

Project Number: MS24-09003


Drawing Number: D1000384

Reference Test Report: R1985.01-303-44 R0

Product Name: LaCantina V2 Aluminum 2 Panel (ISW) 99.45 x 120

Prepared for:

Jeld-Wen Windows & Doors
3737 Lakeport Blvd.
Klamath Falls, OR

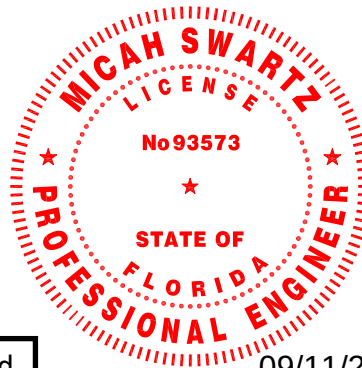

Prepared by:
Micah Swartz, P.E.

A handwritten signature in blue ink that reads "Micah Swartz".

09/11/25 Micah Swartz, PE
Florida License No. PE 93573

This item has been digitally signed and sealed by Micah Swartz, P.E. on the date adjacent to the seal.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

Micah Swartz, P.E.	Project Number:	MS24-09003
	Project Name:	LaCantina V2 Aluminum 2 Panel (ISW)
	Date:	9/8/2025
	Page:	2 of 8

Scope:

Micah Swartz, P.E. is contracted by Jeld-Wen Windows & Doors to evaluate alternative anchorage for the product: LaCantina V2 Aluminum 2 Panel (ISW) 99.45 x 120. This evaluation is based on testing performed by Intertek Building & Construction in Lake Forest, CA, test report no.: R1985.01-303-44 R0 and dated 6/19/24.

This evaluation does not include the air infiltration, water resistance or water penetration of the installation method or the installed product. In addition, the design of the building substrate to resist the superimposed loads is by others.

Reference Standards:

Current edition of the Florida Building Code, Building

ANSI/AWC NDS - National Design Specification (NDS) for Wood Construction

ANSI S100 North American Specification for the Design of Cold-Formed Steel Structural Members

ICC-ES Report ESR-1976 ITW Buildex TEKS Self-Drilling Fasteners

ICC-ES Report ESR-2196 Hilti Self Drilling Screws to connect cold-formed steel

NOA 24-0102.06 Tapcon Concrete and Masonry Anchors with Advanced Threadform Technology

Certification of Independence:

In accordance with Rule 61G20-3 Florida Administrative Code, Micah Swartz, P.E. hereby certifies the following:

(1) Micah Swartz, P.E. does not have, nor does it intend to acquire or will it acquire, a financial interest in any company manufacturing or distributing products tested or labeled by the agency.

(2) Micah Swartz, P.E. is not owned, operated or controlled by any company manufacturing or distributing products it tests or labels.

(3) Micah Swartz, P.E. does not have, nor will acquire, a financial interest in any company manufacturing or distributing products for which the reports are being issued.

(4) Micah Swartz, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.

Micah Swartz, P.E.	Project Number:	MS24-09003	
	Project Name:	LaCantina V2 Aluminum 2 Panel (ISW)	
	Date:	9/8/2025	Page:

Design Summary:

The table below summarizes the product: LaCantina V2 Aluminum 2 Panel (ISW) 99.45 x 120 and their corresponding performance levels as established by testing.

Table 1: Summary of Test Results

Series/Model	Test Report Number	Size (W x H)	Performance
LaCantina V2 Aluminum 2 Panel (ISW) 99.45 x 120	R1985.01-303-44 R0 (6/19/24)	99.45" x 120"	+30 psf / -30 psf

As Tested Design:

Screw Information:

Screw Size: 10 Screw Embed: 1.5 in Edge Distance: 3/4 in (minimum)

Wood Screw Lateral: 149 lbs

Alternative Fasteners:

Screw Information:

Screw Size: 10 Screw Embed: 1.5 in Edge Distance: 3/4 in (minimum)

Wood Screw Lateral: 149 lbs

Tapcon Information:

Tapcon Size: 1/4 Embedment: 1-1/4 in (minimum) Edge Distance: 2-1/2 in (minimum)

Tapcon Lateral (Concrete): 203 lbs

Tapcon Lateral (CMU): 161 lbs

Micah Swartz, P.E.	Project Number: MS24-09003
	Project Name: LaCantina V2 Aluminum 2 Panel (ISW)
	Date: 9/8/2025 Page: 4 of 8

Subject: As Tested - Wood Screw Lateral Design - Single Shear

Input:
 Calculation:

Screw Information:

Screw Size: 10
 Screw Embed: 1.5 in

Root Diameter: 0.152 in

Main Member Type: S-P-F G: 0.42 F_{em}: 3,350 psi thickness (t_m): 1.5 in

Side Member Type: Steel G: N/A F_{es}: 36,000 psi thickness (t_s): 0.06 in

Lateral Design Factors - Table 12.3.1A (NDS)

D:	0.152	in	Diameter
F _{yb} :	90	ksi	Dowel Bending Yield Strength
F _{em} :	3,350	psi	Main Member dowel bearing strength
F _{es} :	36,000	psi	Side Member dowel bearing strength
l _m :	1.5	in	Main Member dowel bearing length
l _s :	0.06	in	Side Member dowel bearing length
R _d :	2.2		Reduction term - Table 12.3.1B (NDS)
R _e :	0.0931		= F _{em} /F _{es}
R _t :	25.0		= l _m /l _s
k ₁ :	0.939		See Table
k ₂ :	0.551		See Table

Reference Lateral Design Values - Table 12.3.1A (NDS)

Z_{I_m}: 347 lbs

$Z_{Im} = \frac{D l_m F_{em}}{R_d} \text{ (EQ 12.3 - 1)}$

Z_{II}: 140 lbs

$Z_{II} = \frac{k_1 D l_s F_{es}}{R_d} \text{ (EQ 12.3 - 3)}$

Z_{III_m}: 161 lbs

$Z_{III_m} = \frac{k_2 D l_m F_{em}}{(1 + 2R_e) R_d} \text{ (EQ 12.3 - 4)}$

Z_{IV}: 142 lbs

$Z_{IV} = \frac{D^2}{R_d} \sqrt{\frac{2 F_{em} F_{yb}}{3(1 + R_e)}} \text{ (EQ 12.3 - 6)}$

Z_{MIN}: 140 lbs

Note: Side member is part of the Jeld-Wen assembly and verified during testing. Modes Z_{Is} and Z_{III_s} are not applicable to the calculation.

Micah Swartz, P.E.	Project Number:	MS24-09003	
	Project Name:	LaCantina V2 Aluminum 2 Panel (ISW)	
	Date:	9/8/2025	Page:

Subject: As Tested - Wood Screw Lateral Design - Single Shear Cont.

Adjusted Lateral Design Values

$Z' = Z * C_D * C_M * C_t * C_g * C_{\Delta}$ – As per table 11.3.1 NDS

C _D :	1.6	Load Duration Factor - Table 2.3.2 (NDS)
C _M :	1.0	Wet Service Factor - Table 11.3.3 (NDS)
C _t :	1.0	Temperature Factor - Table 11.3.4 (NDS)
C _g :	1.0	Group Action Factor - Section 11.3.6 (NDS)
C _Δ :	1.0	Geometry Factor - Section 12.5.1.1 (NDS)

Z': 224 lbs

Fastener Bending Across Shim Space

Ω:	1.67	
L:	0.25	in Maximum Shim Gap
D:	0.152	in Diameter
F _{yb} :	90	ksi Dowel Bending Yield Strength

$$\frac{F_{yb}}{\Omega} = \frac{M}{S} = \frac{16ZL}{\pi D^3} \Leftrightarrow Z = \frac{F_{yb}\pi D^3}{16\Omega L}$$

Where $M = \frac{ZL}{2}$ (Guided Bending)

Z_n/Ω: 149 lbs

Bearing on Masonry Strap

Ω:	3.00	
F _u :	33	ksi Tensile Strength of strap
t:	20	GA
t:	0.036	in thickness of strap
D:	0.152	in

$\frac{P_{nv}}{\Omega} = 2.7 * t * D * F_u$ – (EQ.J4.3.1 – 4, AISI S100)

P_{nv}/Ω: 162 lbs

Subject: Wood Screw Lateral Design - Single Shear

Input:

Calculation:

Screw Information:

Screw Size: 10

Root Diameter: 0.152 in

Screw Embed: 1.5 in

Main Member Type: S-P-F G: 0.42 F_{em} : 3,350 psi thickness (t_m): 1.5 inSide Member Type: S-P-F G: 0.42 F_{es} : 3,350 psi thickness (t_s): 1.25 in**Lateral Design Factors - Table 12.3.1A (NDS)**

D:	0.152	in	Diameter
F_{yb} :	90	ksi	Dowel Bending Yield Strength
F_{em} :	3,350	psi	Main Member dowel bearing strength
F_{es} :	3,350	psi	Side Member dowel bearing strength
l_m :	1.5	in	Main Member dowel bearing length
l_s :	1.25	in	Side Member dowel bearing length
R_d :	2.2		Reduction term - Table 12.3.1B (NDS)
R_e :	1		$= F_{em}/F_{es}$
R_t :	1.2		$= l_m/l_s$
k_1 :	0.459		See Table
k_2 :	1.133		See Table

Reference Lateral Design Values - Table 12.3.1A (NDS)

$$Z_{Im}: 347 \text{ lbs} \quad Z_{Im} = \frac{D l_m F_{em}}{R_d} \text{ (EQ 12.3 - 1)}$$

$$Z_{II}: 133 \text{ lbs} \quad Z_{II} = \frac{k_1 D l_s F_{es}}{R_d} \text{ (EQ 12.3 - 3)}$$

$$Z_{III_m}: 131 \text{ lbs} \quad Z_{III_m} = \frac{k_2 D l_m F_{em}}{(1 + 2R_e) R_d} \text{ (EQ 12.3 - 4)}$$

$$Z_{IV}: 105 \text{ lbs} \quad Z_{IV} = \frac{D^2}{R_d} \sqrt{\frac{2F_{em}F_{yb}}{3(1 + R_e)}} \text{ (EQ 12.3 - 6)}$$

$$Z_{MIN}: 105 \text{ lbs}$$

Note: Side member is part of the Jeld-Wen assembly and verified during testing. Modes Z_{Is} and Z_{III_s} are not applicable to the calculation.

Micah Swartz, P.E.	Project Number:	MS24-09003
	Project Name:	LaCantina V2 Aluminum 2 Panel (ISW)
	Date:	9/8/2025

Subject:

Wood Screw Lateral Design - Single Shear Cont.

Adjusted Lateral Design Values

$Z' = Z * C_D * C_M * C_t * C_g * C_{\Delta}$
- As per table 11.3.1 NDS

C _D :	1.6	Load Duration Factor - Table 2.3.2 (NDS)
C _M :	1.0	Wet Service Factor - Table 11.3.3 (NDS)
C _t :	1.0	Temperature Factor - Table 11.3.4 (NDS)
C _g :	1.0	Group Action Factor - Section 11.3.6 (NDS)
C _Δ :	1.0	Geometry Factor - Section 12.5.1.1 (NDS)

Z' :

168

lbs

Fastener Bending Across Shim Space

Ω:	1.67	
L:	0.25	in Maximum Shim Gap
D:	0.152	in Diameter
F _{yb} :	90	ksi Dowel Bending Yield Strength

$$\frac{F_{yb}}{\Omega} = \frac{M}{S} = \frac{16ZL}{\pi D^3} \Leftrightarrow Z = \frac{F_{yb}\pi D^3}{16\Omega L}$$

Where $M = \frac{ZL}{2}$ (Guided Bending)

Z_n/Ω :

149

lbs

Bearing on Masonry Strap

Ω:	3.00	
F _u :	33	ksi Tensile Strength of strap
t:	20	GA
t:	0.036	in thickness of strap
D:	0.152	in

$$\frac{P_{nv}}{\Omega} = 2.7 * t * D * F_u$$
— (EQ.J4.3.1 – 4, AISI S100)

P_{nv}/Ω :

162

lbs

Micah Swartz, P.E.	Project Number: MS24-09003
	Project Name: LaCantina V2 Aluminum 2 Panel (ISW)
	Date: 9/8/2025 Page: 8 of 8

Subject: Tapcon Lateral Design

Input:

Calculation:

Tapcon Size:

Size:

1/4

D:

0.25

 in

Nominal Diameter

D_{sh}:

0.19

 in

Shank Diameter

Fastener Shear Capacity - 3,000 psi Concrete

P_{nv}/Ω:

237

 lbs

See Table 1B of NOA 24-0102.06

Fastener Shear Capacity - Medium-Weight CMU

P_{nv}/Ω:

161

 lbs

See Table 3 of NOA 24-0102.06

- Note:
- Critical anchor spacing is 16D
 - Minimum Anchor Embedment is 1-1/4"
 - Minimum Edge Distance is 2-1/4"

Fastener Bending Across Shim Space

L:

0.25

 in

Maximum Shim Gap

Ω:

3.00

D_{sh}:

0.19

 in

Shank Diameter of Tapcon

F_{yb}:

100

 ksi

Yield Strength of Tapcon

$$\frac{F_{yb}}{\Omega} = \frac{M}{S} = \frac{16P_n L}{\pi D^3} \Leftrightarrow P_n = \frac{F_{yb} \pi D^3}{16 \Omega L}$$

Where $M = \frac{P_n L}{2}$ (Guided Bending)

P_n/Ω:

539

 lbs

Bearing Strength of Masonry Straps - AISI S100

Size:

1/4

Tapcon Size

Ω:

3.00

D_{sh}:

0.19

 in

Shank Diameter of Tapcon Screw

F_u:

33

 ksi

Tensile Strength of Masonry Strap

t:

20

 GA

t:

0.0359

 in

Thickness of Masonry Strap

$$\frac{P_{nv}}{\Omega} = 2.7 * t * D * F_u - (EQ. J4.3.1 - 3, AISI S100)$$

P_{nv}/Ω:

203

 lbs