

WALTER A. TILLIT, JR., P.E.

tilteco@aol.com
FL P.E. License No. 44167
FL C.A. License No. 0006719

PRODUCT EVALUATION REPORT

REPORT No.: 26-0619.01

DATE: June 19, 2026

PRODUCT CATEGORY: Exterior Doors

PRODUCT SUB-CATEGORY: Sliding Exterior Door Assemblies

PRODUCT NAME: 2 & 3 TRACK SERIES FIW-2004-D ALUMINUM
SLIDING GLASS DOOR (L.M.I)


MANUFACTURER: MIAMI DADE ALUMINUM, CORP
1615 WEST 31 PLACE
HIALEAH, FL 33012

1. PURPOSE OF EVALUATION:

This is a Product Evaluation Report issued by **Walter A. Tillit, Jr., P.E.** (System ID # 1906) to **Miami Dade Aluminum, Corp** based on **Rule Chapter No. 61G20-3, Method 1D** of the **Florida Department of Business and Professional Regulation**.

This product is being issued an Evaluation Report as described herein and has been verified for compliance in accordance with the 2026 9th Edition of the Florida Building Code, and to verify that the product is for the purpose intended at least equivalent to that required by the Code.

This Product Evaluation Report shall be subject to review and revision in case of a Building Code change that may affect its limitations and conditions.

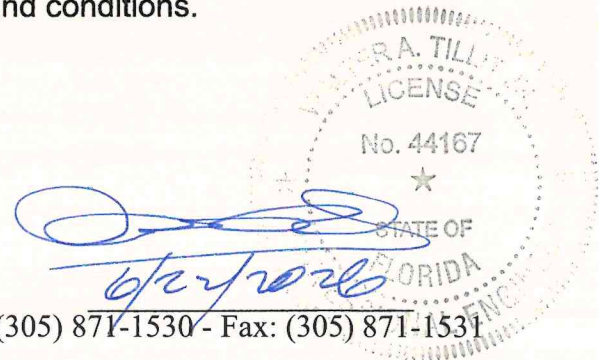

2. EVIDENCE SUBMITTED:

2.1. PRODUCT EVALUATION DOCUMENT (P.E.D.):

Drawing No. 26-088, titled "2 & 3TRACK SERIES FIW-2004-D ALUMINUM SLIDING GLASS DOOR (L.M.I)" sheets 1 thru 11 prepared by **Tilteco, Inc.**; signed and sealed **Walter A. Tillit, Jr., P.E.**; dated 6/15/2026. This drawing is an integral part of this Evaluation Report.

2.2. TEST REPORTS:

Impact and Cyclic Tests as per protocol TAS-201, TAS-203, Uniform Static Load as per Protocol TAS 202 per sections 1626 and 1609.1.2, respectively of the Florida Building Code.

Test reports prepared by Fenestration Testing Laboratory, Inc, Report No.3973, dated 11/24/2003 signed and sealed by Edmundo Largaespada, P.E.

2.3. STRUCTURAL ENGINEERING CALCULATIONS:

On "2 & 3 TRACK SERIES FIW-2004-D ALUMINUM SLIDING GLASS DOOR (L.M.I)" for Maximum Pressure Rating vs. Maximum anchor spacing, maximum width and height and Maximum Glass Size, based on rational, comparative analysis and ASTM E-1300 -16, in accordance with sections 1604, 1616 and 2404.1 of the Florida Building Code. Calculations Prepared by Tilteco, Inc., dated 4/17/2024, signed and sealed by Walter A. Tillit, Jr., P.E.

3. MISSILE IMPACT RESISTANCE:

Large Missile Impact resistance is provided per TAS 201 (9 lbs., 50 feet/sec, Large Missile).

4. WIND LOADS RESISTANCE:

On "2 & 3 TRACK SERIES FIW-2004-D ALUMINUM SLIDING GLASS DOOR (L.M.I)" has been verified to sustain wind pressures. Maximum Glass Panel Dimensions, Panel Width, & Panel Height shall be as indicated on sheets 4, 5, 6, 9, 10 & 11 of Product Evaluation Document (P.E.D), Drawing No. 26-088.

Maximum Design Pressure Rating for Stiles Top and Bottom connections with Fasteners Clusters for applicable substrates shall be as indicated on sheets 4 & 9, of Product Evaluation Document (P.E.D), Drawing No.26-088.



5. INSTALLATION:

Installation shall be performed strictly in accordance with General Notes # 1 thru 7 9 thru 11, indicated on sheet 1 and details indicated on sheets 4 thru 6 and 9 THRU 11 OF Product Evaluation Document (P.E.D.), drawing No. **26-088**.

Gaskets and setting blocks used at installations comply with section 2411.3.4 of the Florida Building Code as specified on Bill of Materials on Sheets 2 and 7 of Product Evaluation Document (P.E.D.), drawing No. **26-088**.

6. MATERIAL CHARACTERISTICS AND SPECIFICATIONS:

Shall be strictly in accordance with General Notes and Components indicated on sheets 2, 3, 7 & 8 of Product Evaluation Document (P.E.D.), Drawing No. **26-088**.

Anchor specifications shall be as indicated on Note 8, sheet 1 of Product Evaluation Document (P.E.D.), Drawing No. **26-088**.

7. LIMITATIONS AND CONDITIONS OF USE:

7.1. Shall be strictly in compliance with General Notes No. 1 thru 5, indicated on sheet 1 of Product Evaluation Document (P.E.D.), Drawing No. **24-038** prepared by Tilteco, Inc. and signed and sealed by Walter A. Tillit, Jr., P.E.

7.2. Product may be installed within HIGH VELOCITY HURRICANE ZONES as defined on section 202 of the Florida Building Code and out of it.

7.3. Product shall only be installed into substrates with limitations as indicated on sheets 5, 6, 10 & 11 and General Note 8, sheet 1 of Product Evaluation Document (P.E.D.), Drawing No. **26-088**.

Product Evaluation Report prepared by Walter A. Tillit, Jr., P.E. (Florida License No. 44167), President of Tilteco, Inc. (Florida CA-0006719).

WAT\ma

D:\TILTECO ADMIN RECORDS \ P. E. REPORT.26 \MIAMI DADE ALUMINUM, CORP \ 2 & 3 TRACK SERIES FIW-2004-D ALUMINUM SLIDING GLASS DOOR (L.M.I) \ DRWG # 26-088 \ REPORT #26-0619.01

