



EVALUATION REPORT

FLORIDA BUILDING CODE, 9TH EDITION (2026)

Manufacturer: GAF
1 Campus Drive
Parsippany, NJ 07054
(877) 423-7663
www.gaf.com

Issued July 24, 2026

Manufacturing Location: Pryor, OK

Quality Assurance: Keystone Certifications, Inc. (QUA1824)

SCOPE

Category: Roofing
Subcategory: Underlayments
Code Edition: Florida Building Code, 9th Edition (2026) including High-Velocity Hurricane Zones (HVHZ)
Code Sections: 1507.1.1, 1518.2
Properties: Physical properties

REFERENCES

<u>Entity</u>	<u>Report No.</u>	<u>Standard</u>	<u>Year</u>
PRi Construction Materials Technologies (TST5878)	1047T0069	ASTM D 1970 TAS 110	2021 2000

PRODUCT DESCRIPTION AND LIMITS OF USE

GAF Seam Tape GAF Seam Tape is a nominal 60-mil thick ASTM D 1970 self-adhered tape constructed with a SBS polymer modified asphalt top coating and a non-abrasive UV stable, polymer film. The product is supplied in with nominal dimensions of 4-in, x 67-ft.

PRODUCT APPLICATION

Min. Roof Slope: 2:12 in accordance with the FBC

Roof Deck: Shall be in accordance with the FBC requirements.

Application: *Shall be installed in accordance with the FBC and the manufacturer's installation requirements.*

Substrates shall be clean, dry, and free from any irregularities and debris. All fasteners in the substrate shall be checked for protrusion and corrected prior to underlayment application. Prior to beginning installation, the product shall be unrolled and allowed to relax for a minimum of 3-5 minutes.

GAF Seam Tape shall be installed with the release backer removed and pressed firmly into place to ensure complete contact with the substrate.

Min. Application Temperature: 40°F and rising; *Contact the manufacturer when installing at temperatures below the minimum application temperature.*


Roof Coverings: Shall be in accordance with the FBC requirements.

GENERAL LIMITATIONS

1. Fire Classification is not within the scope of this evaluation.
2. Installation of the evaluated product shall comply with this report, the FBC, and the manufacturer's published application instructions. Where discrepancies exist between these sources, the more restrictive and FBC compliant installation detail shall prevail.
3. The space under the deck area shall be properly ventilated in accordance with the FBC requirements.
4. The roof deck shall be designed by others in accordance with FBC requirements to resist the design wind load pressures for components and cladding.
5. All materials shall conform to FBC Section 1506 outside of the HVHZ and FBC Section 1517 within the HVHZ.
6. All products listed in this report shall be manufactured under a quality assurance program in compliance with Rule 61G20-3.

COMPLIANCE STATEMENT

This report has been prepared in accordance with F.A.C. Rule 61G20-3.

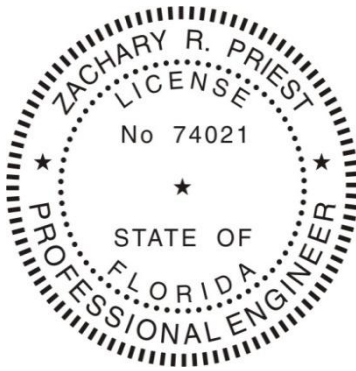

This item has been
digitally signed and
sealed by Zachary R.
Priest, PE, on 7/24/2026.

Printed copies of this
document are not
considered signed and
sealed and the signature
must be verified on any
electronic copies.


Digitally signed by Zachary R. Priest

2026.07.24
16:28:36
-04'00'

Zachary R. Priest, P.E.
Florida Registration No. 74021
Organization No. ANE9641

CERTIFICATION OF INDEPENDENCE

CREEK Technical Services, LLC does not have, nor will it acquire, a financial interest in any company manufacturing or distributing products under this evaluation.

CREEK Technical Services, LLC is not owned, operated, or controlled by any company manufacturing or distributing products under this evaluation.

Zachary R. Priest, P.E. does not have, nor will acquire, a financial interest in any company manufacturing or distributing products under this evaluation.

Zachary R. Priest, P.E. does not have, nor will acquire, a financial interest in any other entity involved in the approval process of the product.

END OF REPORT