



1900 NE MIAMI CT. SUITE 2-15, MIAMI, FL 33132

Product Evaluation Report

of

**Cantera Doors and More Inc.
Fixed Steel Impact Window
(HVHZ) (Impact)**

for

Florida Product Approval

FL# FL47427

Report No. 11825

Current Florida Building Code

Method: 1 – A (Certificate)
Category: Windows
Sub – Category: Fixed

Product: Fixed Steel Impact Window
Materials: Steel
Product Dimensions: See Installation Instructions, CND001

Prepared for:

**Cantera Doors and More Inc.
22108 Hwy-71 West, Suite 4-404
Spicewood, TX 78669**

Prepared by:

Hermes F. Norero, P.E.


Florida Professional Engineer #73778

Date: 9/16/2026

Contents:

Evaluation Report

Pages 1 – 3

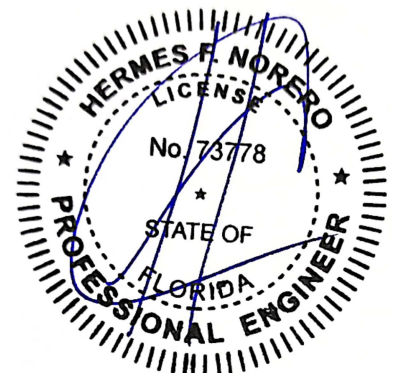

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.09.18 12:14:15 -04'00'

Hermes F. Norero, P.E.
Florida P.E. No. 73778

1900 NE MIAMI CT. SUITE 2-15, MIAMI, FL 33132

Manufacturer: Cantera Doors and More Inc.

Product Category: Windows

Product Sub-Category: Fixed

Compliance Method: State Product Approval Method (1)(a)

Product Name: Fixed Steel Impact Window (HVHZ) (Impact)

Scope: This is a Product Evaluation Report issued by Hermes F. Norero, P.E. (FL #73778) for **Cantera Doors and More Inc.** based on Method 1a of the State of Florida Product Approval, Department of Business and Professional Regulation - Florida Building Commission.

Hermes F. Norero, P.E. does not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

This product has been evaluated for use in locations adhering to the current Florida Building Code.

See Installation Instructions **CND001**, signed and sealed by Hermes F. Norero, P.E. (FL#73778) for specific use parameters.

Limits of Use:

1. This product has been evaluated and is in compliance with the current Florida Building Code, **including** the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment into substrate material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with Chapter 16 of the current Florida Building Code and **does not require** an impact resistant covering.
4. Site conditions that deviate from the details of installation instructions **CND001** require further engineering analysis by a licensed engineer or registered architect.
5. See Installation Instructions **CND001** for size and design pressure limitations.

Certification Agency: The manufacturer has demonstrated compliance of manufacture of products in accordance with the Florida Building Code for manufacturing under audit by an approved certification agency entity through **National Accreditation & Management Institute** (FBC Organization # CER1773).

Performance Standards: The product described herein has been evaluated per:

- AAMA/WDMA/CSA 101/I.S.2/A440-17
- TAS 201-94
- TAS 202-94
- TAS 203-94

Referenced Data:

1. Product Testing performed by **PRI Construction Materials Technologies LLC.**
(FBC Organization # **TST5878**)
Report #: Dated:
2829T0002A 07/29/2025
2829T0002B 07/29/2025
2829T0002C 07/29/2025
2829T0003A 07/29/2025
Signed and sealed by Zachary Priest, FL P.E. No. 74021
2. Material Certification
(**Miami Dade County Notice of Acceptance**)
Sentryglas Interlayer by Kuraray America, Inc.
3. Certification Agency
National Accreditation & Management Institute
(FBC Organization #: CER1773)

Installation:

Refer to Installation Instructions (**CND001**) for anchor spacing and more details of the installation requirements.

Design Pressure:

Refer to Installation Instructions (**CND001**) for design pressures based on size, configuration, and glass types.