BUILDING DROPS
1900 NE MIAMI CT. SUITE 2-15, MIAMI, FL 33132

Product Evaluation Report

of

Cantera Doors and More Inc.
Inswing/Outswing Steel Impact Doors
(HVHZ) (Impact)

for

Florida Product Approval

FL# FL47429

Report No. 9910

Current Florida Building Code


Method:	**1 – A (Certificate)**
Category:	**Exterior Doors**
Sub – Category:	**Swinging Exterior Door Assemblies**
Product:	**Inswing/Outswing Steel Impact Doors**
Materials:	**Steel**
Product Dimensions:	**See Installation Instructions, CND003**

Prepared for:

Cantera Doors and More Inc.
22108 Hwy-71 West, Suite 4-404
Spicewood, TX 78669

Prepared by:

Hermes F. Norero, P.E.
Florida Professional Engineer # 73778
Date: 2/9/2026

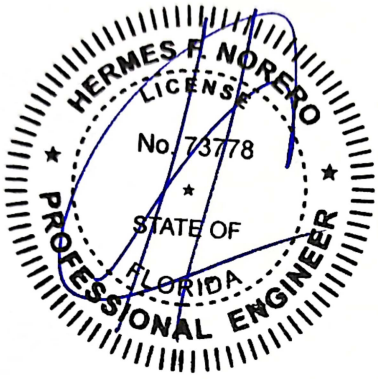

Contents:

Evaluation Report Pages 1 – 3

Digitally signed by Hermes F. Norero, P.E.
Reason: I am approving this document
Date: 2026.02.09 13:49:57 -05'00'

Hermes F. Norero, P.E.
Florida P.E. No. 73778

Manufacturer: **Cantera Doors and More Inc.**

Product Category: Exterior Doors

Product Sub-Category: Swinging Exterior Door Assemblies

Compliance Method: State Product Approval Method (1)(a)

Product Name: **Inswing/Outswing Steel Impact Doors (HVHZ) (Impact)**

Scope: This is a Product Evaluation Report issued by Hermes F. Norero, P.E. (FL # 73778) for **Cantera Doors and More Inc.** based on Method 1A of the State of Florida Product Approval, Department of Business and Professional Regulation - Florida Building Commission.

Hermes F. Norero, P.E. does not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

This product has been evaluated for use in locations adhering to the current Florida Building Code.

See Installation Instructions **CND003**, signed and sealed by Hermes F. Norero, P.E. (FL#73778) for specific use parameters.

Limits of Use:

1. This product has been evaluated and is in compliance with the current Florida Building Code, **including** the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment into substrate material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with Chapter 16 of the current Florida Building Code and **does not require** an impact resistant covering in Wind Zone 4.
4. Site conditions that deviate from the details of installation instructions **CND003** require further engineering analysis by a licensed engineer or registered architect.
5. See Installation Instructions **CND003** for size and design pressure limitations.

954.399.8478 954.744.4738
BUILDINGDROPS.COM CONTACT@BUILDINGDROPS.COM

Certification Agency: The manufacturer has demonstrated compliance of manufacture of products in accordance with the Florida Building Code for manufacturing under audit by an approved certification agency entity through **National Accreditation & Management Institute** (FBC Organization # CER1773).

Performance Standards: The product described herein has been evaluated per:

- AAMA/WDMA/CSA 101/I.S.2/A440-17
- TAS 201-94
- TAS 202-94
- TAS 203-94

Referenced Data:

1. Product Testing performed by **PRI Construction Materials Technologies LLC.**
   (FBC Organization # **TST5878**)
   Report #: 2829T0003A
   Dated: 10/16/2025
   Signed and sealed by Zachary Priest, FL P.E. No. 74021

2. Material Certification
   (Miami Dade County Notice of Acceptance)
   Sentryglas Interlayer by Kuraray America, Inc.

3. Certification Agency
   National Accreditation & Management Institute
   (FBC Organization #: CER1773)

Installation:

Refer to Installation Instructions (**CND003**) for anchor spacing and more details of the installation requirements.

Design Pressure:

Refer to Installation Instructions (**CND003**) for design pressures based on size, configuration, and glass types.

954.399.8478 954.744.4738
BUILDINGDROPS.COM CONTACT@BUILDINGDROPS.COM