




En3 Engineering & Consultancy

PRODUCT EVALUATION REPORT

Date: April 21, 2025

Product: **SB752 SPLIT MULLION CURTAINWALL SYSTEM**
Non-Impact / Non-HVHZ

Manufacturer: **Trulite Glass and Aluminum Solutions**
1750 Founders PKWY, Ste. 154
Alpharetta GA, 30009
P (800) 432-8132

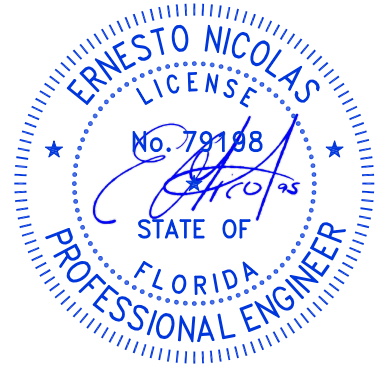

Prepared by: Ernesto Nicolas, P.E. FL #79198

Scope: This report evaluates the above listed product per the requirements of FAC Product Approval Rule Chapter 61G20-3.005, using Method 1-D (Engineering Evaluation). This product complies with the requirements of the 2023 Florida Building Code 8TH Edition, to be used outside of the High Velocity Hurricane Zone.

Test Reports:

Tested in accordance with AAMA 501

Test Laboratory	Report Number	Test Report Date	Test Standard
Intertek	R8840.01-450-44 R0, signed and sealed by Tanya Dolby, P.E. FL#93536	December 17, 2024	AAMA 501-15 ASTM E283-04(2012) ASTM E331-00(2016) ASTM E330/E330M-14
Intertek	R5991.01-450-18 R0, signed and sealed by Tanya Dolby, P.E. FL#93536	January 07, 2025	TAS 202, TAS 201, TAS 203
Fenestration Testing Laboratory	9309, signed and sealed Idalmis Ortega, P.E. 76905	April 27, 2017	TAS 202, TAS 201, TAS 203
Fenestration Testing Laboratory	8022, signed and sealed by Idalmis Ortega, P.E. 76905	April 20, 2016	TAS 202, TAS 201, TAS 203

Technical Documentation:

- 1) Installation Drawings #25FL-102, Signed and Sealed by Ernesto Nicolas, P.E. (FL# 79198)

Limitations of Use for this product:

- See Installation Drawings #25FL-102 for approved anchor methods and spacing.
- Product is non-impact rated.



En3 Engineering & Consultancy

- To be used outside the High Velocity Hurricane Zone.
- See Installation Drawings #25FL-102 for size and design pressure limitations.
- Site conditions that deviate from the Installation Drawings #25FL-102 require further engineering analysis by a licensed engineer or registered architect.