L. Roberto Lomas P.E.
208 7th Ave
Indialantic, FL 32903
434-688-0609
rllomas@lrlomaspe.com

Engineering Evaluation Report

Report No.: 515548A

Manufacturer: NT Window, Inc.
2900 West Seminary Dr.
Fort Worth, TX 76133

Product Line: 5902 Vertical/Horizontal Mullion

Compliance:
The product listed herein complies with requirements of the current Florida Building Code.

Supporting Technical Documentation:
1. Approval document: drawing number 08-04162, prepared, signed and sealed by Luis Roberto Lomas P.E.
2. Mullion analysis with anchor calculations, report number 515548-1 per AAMA 450 option 3, prepared, signed and sealed by Luis Roberto Lomas P.E.

Limitations and Conditions of use:
- Design pressure: Refer to design pressure charts in approval document.
- Mullion span: Refer to charts in approval document
- Window units attached to mullion must have their own separate approval.
- This product is not rated to be used in the HVHZ.
- This product is impact resistant and does not require impact protection in wind borne debris regions, up to wind zone 3.
- Design pressure of mulled units shall be controlled by the lesser design pressure of the assembly components; mullion or individual units.
- All windows attached to mullion must be manufactured by NT Window, Inc.

Installation:
Mullion must be installed in accordance with manufacturer's installation instructions and approval document 08-04162.

When the product specified herein is installed within 3000 ft. of a saltwater coastline, all anchors and clips must comply with saltwater environment corrosion resistance requirements of FBC Chapter 17.

Certification of Independence:
Please note that I do not have nor will acquire a financial interest in any company manufacturing or distributing the product(s) for which this report is being issued. Also, I do not have nor will acquire a financial interest in any other entity involved in the approval process of the listed product(s).

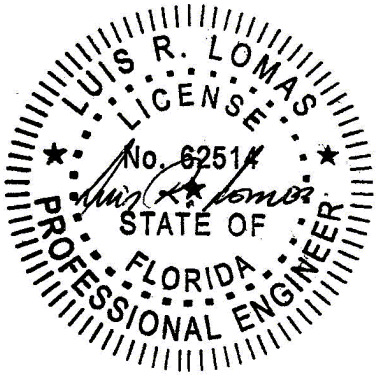

Luis R. Lomas, P.E.
FL No.: 62514
07/15/2026