

Evaluation Report FPA-64-SH
January 19, 2026

Product Description: Series 64 Single Hung Window (Finless), Non-Impact

Manufacturer: Finestra Window & Door, 5 Trautman Industrial Ct., Ste. Genevieve, MO

Statement of Compliance: This report evaluates the above-listed product per the requirements of FAC Product Approval Rule Chapter 61G20-3.005 (4). This product complies with the requirements of the 8th Edition (2023) Florida Building Code outside the High Velocity Hurricane Zone. The product testing standards performed are outlined below.

Technical Documentation:


- 1) This report, prepared by Lucas A. Turner, PE, at 2428 Old Natchez Trc Trl, Camden, TN
- 2) Approval drawing FPA-64-SH, signed and sealed by Lucas A. Turner, P.E.
- 3) Test Report CCL 25-281, by Construction Consulting Laboratory, Carrollton, TX, with testing performed with equivalency to: AAMA/WDMA/CSA 101/I.S.2/A440-17/22
- 4) Supplemental Calculations to support FPA-64-SH, signed and sealed by Lucas A. Turner, P.E.

Installation: Units must be installed according to approval document FPA-64-SH.

Limitations of Use: This product:

- May be used up to the sizes and daylight openings indicated in FPA-64-SH
- Achieves design pressures of +/-50 psf
- Is non-impact resistant and requires the use of shutters in windborne debris areas
- May not be used in the High Velocity Hurricane Zone
- Requires Veka rigid PVC frame extrusions

Certification of Independence: I do not have, nor do I intend to acquire, nor will I acquire, a financial interest in Finestra Window & Door or in any company manufacturing or distributing products for which this report is being issued. I do not have, nor do I intend to acquire, nor will I acquire, a financial interest in any other entity involved in the testing or approval process of this product.

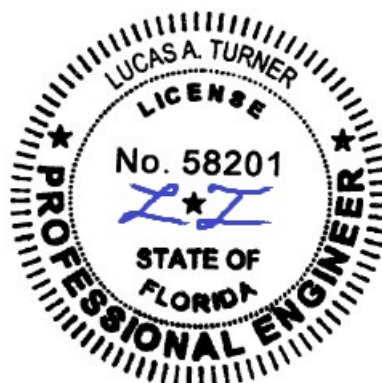

Lucas Turner
2026.01.19
14:45:05
-06'00'

1/19/2026
Lucas A. Turner, P.E.
FL PE #58201