

Product Evaluation Report

of

Drutex S.A.

**IGLO EDGE Fixed Window
(HVHZ) (Impact)**

for

Florida Product Approval

FL# FL48010

Report No. 10903

Current Florida Building Code

Method:	1 – D (Engineering Evaluation)
Category:	Windows
Sub – Category:	Fixed
Product:	IGLO EDGE Fixed Window (HVHZ) (Impact)
Materials:	uPVC
Product Dimensions:	See Installation Instructions, DRU067

Prepared for:

Drutex S.A.

**Leszka Gierszewskiego 1, 77-100
Bytow, Poland**

Prepared by:

Hermes F. Norero, P.E.


Florida Professional Engineer # 73778

Date: 7/9/2026

Contents:

Evaluation Report

Pages 1 – 4

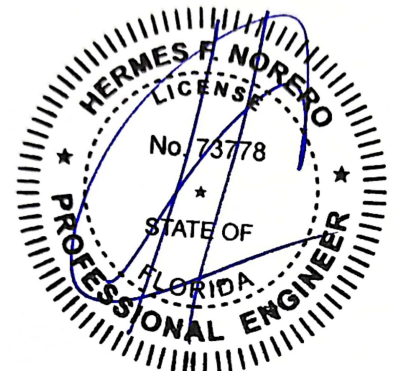

1900 NE MIAMI CT. SUITE 2-15, MIAMI, FL 33132

Manufacturer: Drutex S.A.

Product Category: Windows

Product Sub-Category: Fixed

Compliance Method: State Product Approval Method (1)(d)

Product Name: IGLO EDGE Fixed Window
(HVHZ) (Impact)

Scope: This is a Product Evaluation Report issued by Hermes F. Norero, P.E. (FL # 73778) for **Drutex S.A.** based on Method 1d of the State of Florida Product Approval, Department of Business and Professional Regulation - Florida Building Commission.

Hermes F. Norero, P.E. does not have nor will acquire financial interest in the company manufacturing or distributing the product or in any other entity involved in the approval process of the product named herein.

This product has been evaluated for use in locations adhering to the current Florida Building Code.

See Installation Instructions **DRU067**, signed and sealed by Hermes F. Norero, P.E. (FL # 73778) for specific use parameters.

Limits of Use:

1. This product has been evaluated and is in compliance with the current Florida Building Code, **including** the "High Velocity Hurricane Zone" (HVHZ).
2. Product anchors shall be as listed and spaced as shown on details. Anchor embedment into substrate material shall be beyond wall dressing or stucco.
3. When used in areas requiring wind borne debris protection this product complies with Chapter 16 of the current Florida Building Code and **does not** require an impact resistant covering.
4. Site conditions that deviate from the details of installation instructions **DRU067** require further engineering analysis by a licensed engineer or registered architect.
5. See Installation Instructions **DRU067** for size and design pressure limitations.

Quality Assurance:

The manufacturer has demonstrated compliance of manufacture of products in accordance with the current Florida Building Code for manufacturing under a quality assurance program audited by an approved quality assurance entity through **Keystone Certifications, Inc.**
(FBC Organization #QUA1284)

Performance Standards:

The product described herein has been evaluated per:

- TAS 201-94
- TAS 202-94
- TAS 203-94
- AAMA/WDMA/CSA 101/I.S.2/A440-17
- ASTM E1886-19
- ASTM E1996-20

Referenced Data:

1. Product Testing performed by **BlackwaterTestingsrl**
(FBC Organization #TST14034)
Report #: BW-DRU-25-008-001 Report Date: 12/04/2025
Signed and sealed by Roberto Archila, P.E. No. 53306
2. Material Testing performed by **Architectural Testing, Inc. (an Intertek Company) – York, PA**
(FBC Organization #TST1558)
Report #: P3540.01-106-18 R0 Report Date: 08/18/2023
P3540.02-106-31 R0 08/18/2023
Signed and sealed by Tanya A. Dolby, P.E. No. 93536
3. Quality Assurance
Keystone Certifications, Inc.
(FBC Organization #QUA1284)
4. Material Certification
Miami-Dade County Notice of Acceptance
Kuraray America, Inc.
Trosifol PVB Interlayer

1900 NE MIAMI CT. SUITE 2-15, MIAMI, FL 33132

Installation:

Refer to Installation Instructions (**DRU067**) for anchor spacing and more details of the installation requirements.

Design Pressure:

Refer to Installation Instructions (**DRU067**) for design pressures based on size, configuration, and glass types.