

Manufacturer: Nan Ya Plastics Corporation U.S.A.
8989 North Loop East
Houston, TX 77029

Product Line: Series "SLPS" Glazed Fiberglass Inswing Side-Hinged Door Assembly w/Sidelites, Non-Impact

Compliance:


The product listed herein complies with requirements of the current Florida Building Code.

Supporting Technical Documentation:

1. Approval document: drawing number 08-04185, prepared, signed and sealed by Luis Roberto Lomas P.E.
2. Report No.: 2598T0016 signed by Timothy Efaw
AAMA/WDMA/CSA 101/I.S.2/A440
Design pressure: ± 40.0 psf
3. Report No.: NCTL 210-4103-03 (Neulite panel) signed by Christopher Bennett
National Certified Testing Laboratories, Orlando, FL
AAMA/WDMA/CSA 101/I.S.2/A440
Design pressure: ± 50.0 psf
Water penetration resistance 6.0psf
4. Report No.: FTL 6718 (Excel panel) signed and sealed by Mr. Marlin D. Brinson, P.E.
Fenestration Testing Laboratory, Inc., Medley, FL
AAMA/WDMA/CSA 101/I.S.2/A440
Design pressure: ± 50.0 psf
Water penetration resistance 7.5psf
5. Report No.: NCTL 210-3878-1 (Masterpiece panel) signed by Mark Bennett
National Certified Testing Laboratories, Orlando, FL
AAMA/WDMA/CSA 101/I.S.2/A440
Design pressure: ± 45.0 psf
Water penetration resistance 6.75psf
6. Report No.: NCTL 210-3973-02 (Neuma panel) signed by Christopher Bennett
National Certified Testing Laboratories, Orlando, FL
AAMA/WDMA/CSA 101/I.S.2/A440-08
Design pressure: ± 50.0 psf
Water penetration resistance 7.5psf
7. Report No.: 2598T0003 signed by Timothy Efaw
PRI Construction Materials Technologies LLC, Tampa, FL.
(For PVC Foam Board)
AAMA/WDMA/CSA 101/I.S.2/A440
Design pressure: ± 50.13 psf
8. Anchor calculations, report number 515595-1, prepared, signed and sealed by Luis Roberto Lomas P.E.

Limitations and Conditions of use:

- Design pressure: ± 40.0 psf
- Panel size: 34 3/8" x 76 15/16"
- Approved configurations: X, X/O, O/X, OX, XO, OX/O, XO/O, XX, XX/O, O/XX, OOX, O/OX, OO/X, OXX, XXO, OXX/O and O/XXO.
- Units must be glazed per ASTM E1300, with safety glazing.
- This product is not rated to be used in the HVHZ.
- This product is not impact resistant and requires impact protection in wind borne debris regions.
- Frame material to be Composite.
- This product was not tested for water infiltration resistance and must be installed only in areas where water penetration resistance is not required.

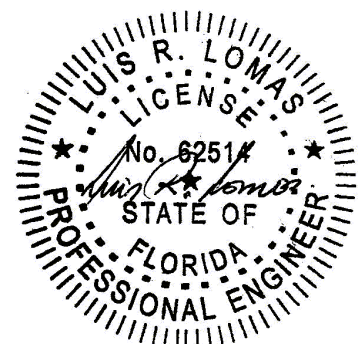

L. Roberto Lomas P.E.

208 7th Ave

Indialantic, FL 32903

434-688-0609

rlomas@lrlomaspe.com

Engineering Evaluation Report

Report No.: 515595

Installation:

Units must be installed in accordance with manufacturer's installation instructions and approval document 08-04185.

Certification of Independence:

Please note that I do not have nor will acquire a financial interest in any company manufacturing or distributing the product(s) for which this report is being issued. Also, I do not have nor will acquire a financial interest in any other entity involved in the approval process of the listed product(s).

