

SHANDONG DOORWIN CONSTRUCTION CO., LTD. FLORIDA BUILDING CODE TEST REPORT

SCOPE OF WORK

TAS 201, TAS 202 AND TAS 203 TESTING ON 95S THERMAL BREAK ALUMINUM HINGED DOORS.

REPORT NUMBER

250815008SHF-001

TEST DATE(S)

2025-11-28 – 2025-12-01

ISSUE DATE

2026-01-15

RECORD RETENTION END DATE

2035-12-01

LABORATORY CERTIFICATION NO.

TST 11491


PAGES

26

DOCUMENT CONTROL NUMBER

LFT-APAC-SHF-OP-10p (September 1, 2022)

© 2022 INTERTEK

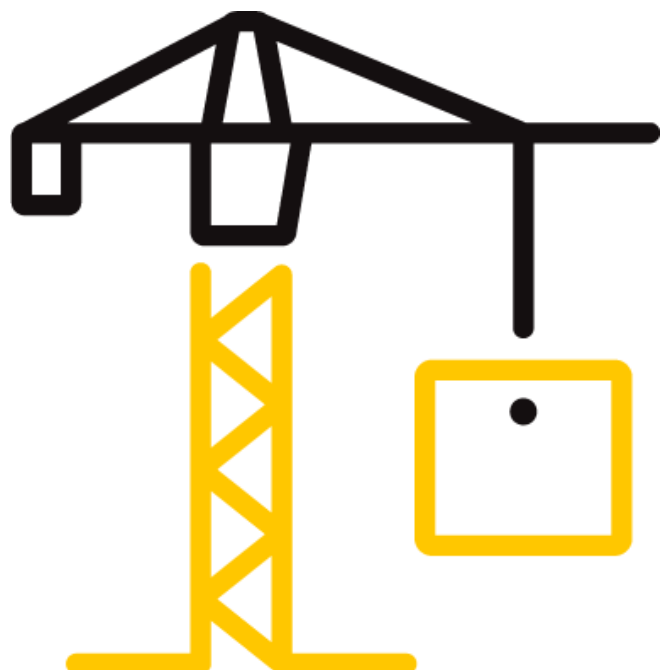

TEST REPORT

Issue Date: 2026-01-15

Intertek Report No.: 250815008SHF-001

REPORT ISSUED TO

SHANDONG DOORWIN CONSTRUCTION CO., LTD.

No.7027, Dongtai Road, Dongcheng Sub-district, Linqu County, Weifang City, Shandong Province, China.

SECTION 1

SCOPE

Intertek Building & Construction (B&C) was contracted by Shandong Doorwin Construction Co., Ltd. to perform TAS 201, TAS 202 and TAS 203 testing in accordance with Florida Building Code for High Velocity Hurricane Zone requirements on their 95S Thermal Break Aluminum Hinged Doors. Results obtained are tested values and were secured by using the designated test method(s). Testing was conducted at the Intertek B&C test facility in Plant 3-5, No. 6978 Daye Road, Fengxian District, Shanghai, China. This report does not constitute certification of this product nor an opinion or endorsement by this laboratory. Unless differently required, Intertek reports apply the "Simple Acceptance" rule, also called "Shared Risk approach", of ILAC-G8:09/2019, Guidelines on Decision Rules and Statements of Conformity.

SECTION 2


SUMMARY OF TEST RESULTS

The specimen(s) tested met the performance requirements set forth in the protocols.

Product Type: Side-hinged Door

Series/Model: DW95S

SPEC.	TEST PROTOCOL	DESIGN PRESSURE
#01	TAS 202 TAS 201/203 (Large Missile)	+60.0 / -60.0 psf
#02 and #03	TAS 202 (Structural only) TAS 201/203 (Large Missile)	+60.0 / -60.0 psf

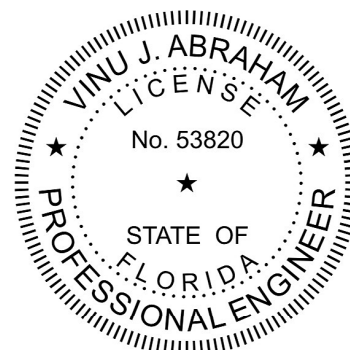

For INTERTEK B&C:

COMPLETED BY:	Fred Bao
TITLE:	Assistant Technical Manager – Intertek B&C
SIGNATURE:	
DATE:	2026-01-15

REVIEWED BY:	Vinu Abraham, P.E.
TITLE:	Vice President Intertek B&C
SIGNATURE:	
DATE:	2026-01-15

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.

The report was digital signed by Shang Hai, Intertek Group plc, please using Adobe Acrobat Reader to verify the authenticity.

TEST REPORT

Issue Date: 2026-01-15

Intertek Report No.: 250815008SHF-001

SECTION 3

TEST METHOD(S)

The specimens were evaluated in accordance with the following:

TAS 201-94, *Impact Test Procedures*

TAS 202-94, *Criteria for Testing Impact & Nonimpact Resistant Building Envelope Components Using Uniform Static Air Pressure*

TAS 203-94, *Criteria for Testing Products Subject to Cyclic Wind Pressure Loading*

SECTION 4

MATERIAL SOURCE/INSTALLATION

Test specimen(s) were provided by the client. Representative samples of the test specimen(s) will be retained by Intertek B&C for a minimum of ten years from the test completion date.

The specimen was installed into a pine wood test buck. The rough opening allowed for a 3/8" shim space. The exterior perimeter of the window was sealed with sealant. Installation of the tested product was performed by the client.

LOCATION	ANCHOR DESCRIPTION	ANCHOR LOCATION
Head	3/16" DIA. x 1-1/2" Length Anchor Screw.	Anchor 7-7/8" from ends and 11-3/4" on center.
jambs	3/16" DIA. x 1-1/2" Length Anchor Screw.	Anchor 6-7/8" from ends and 11-3/4" on center.

SECTION 5

EQUIPMENT

Cannon: Constructed from steel piping utilizing compressed air to propel the missile

Missile: 2x4 Southern Pine.

Timing Device: Electronic beam type.

Cycling Mechanism: Computer controlled centrifugal blower with electronic pressure measuring device.

Deflection Measuring Device: Linear transducers.

TEST REPORT

Issue Date: 2026-01-15

Intertek Report No.: 250815008SHF-001

SECTION 6

LIST OF OFFICIAL OBSERVERS

NAME	COMPANY
Vencent Xu	Shandong Doorwin Construction Co., Ltd.
Hanson He	Shandong Doorwin Construction Co., Ltd.
Fred Bao	Intertek B&C
Gio Liu	Intertek B&C
Zac Zhang	Intertek B&C
Ron Liu	Intertek B&C

SECTION 7

TEST SPECIMEN DESCRIPTION

Product Type: Side-hinged Door

Series/Model: DW95S

Product Size(s): Specimen #01, #02 and #03

OVERALL AREA:	WIDTH	HEIGHT
26.37 ft ²	inches	inches
Overall Size	39-3/8	96-1/2
Exterior Sash	37-1/8	94-1/8

Frame Construction: Specimen #01, #02 and #03

FRAME MEMBER	PART #	MATERIAL	DESCRIPTION
Exterior Frame KY95M001B	P01	6063-T5 Extruded Aluminum	1-3/8" wide by 1-3/8" high, 45° bevel cutting electrostatic powder coating.
Thermal Break BT4004	P07	PA66	1-9/16" wide by 1/4" high, 45° square cut.
Thermal Break BT4005	P08	PA66	1-9/16" wide by 7/16" high, 45° square cut.
Interior Frame KY95M01A	P02	6063-T5 Extruded Aluminum	1-1/16" Wide by 2-5/16" High, 45° bevel cutting electrostatic powder coating.
JOINERY TYPE DETAIL			
All Corners	Aluminum corner connector	Jambs were 45° angle cut, connect the frame with corner key HLG26, fixed with 1/4"x1/2" corner key screws, sealant with P39.	

TEST REPORT

Issue Date: 2026-01-15

Intertek Report No.: 250815008SHF-001

Door Sash Construction: Specimen #01, #02 and #03

SASH MEMBER	PART #	MATERIAL	DESCRIPTION
Exterior Panel KY95M003A	P03	6063-T5 Extruded Aluminum	1-3/8" wide by 3-13/16" high, 45° bevel cut electrostatic powder coating.
Thermal Break BT4006	P09	PA66	1-9/16" wide by 9/16" high, bevel 45° square cut.
Thermal Break BT4004	P07	PA66	1-9/16" wide by 1/4" high, 45° square cut.
Interior Panel KY95M003B	P04	6063-T5 Extruded Aluminum	1-1/16" wide by 1-15/16" high, 45° bevel cut electrostatic powder coating.
		JOINERY TYPE	DETAIL
All Corners	Aluminum corner connector		Jambs were 45° angle cut, connect the frame with corner key HLG42& HLG38, fixed with 1/4"x1/2" corner key screws, sealant with P39

Reinforcement: *No reinforcement was utilized*

Weather stripping: Specimen #01, #02 and #03

DESCRIPTION	QUANTITY	LOCATION
3/8" W by 5/16"H gasket VD70	4 Rows	At door sash frame exterior perimeter for frame-sash clearance.
1-13/16" W by 7/8"H central gasket KY9546	4 Rows	At frame perimeter for frame-sash clearance.
3/16" W by 3/8"H central gasket KY85013	4 Rows	At frame interior perimeter for frame-sash clearance.

Glazing: *No conclusions of any kind regarding the adequacy or inadequacy of the glass in any glazed test specimen(s) can be made. Specimen #01, #02 and #03*

GLASS TYPE	OVERALL THICKNESS	GLASS MAKEUP	GLAZING METHOD
Insulation Laminated Glass	1-5/16"	3/8" fully tempered glass 1/2" air space 1/4" fully tempered glass 0.07" SGP film by KURARAY Co., Ltd. 1/4" fully tempered glass	Glazed by assembling the frame members around the glass and sealed on the interior and exterior with 3/16" wide by 1-1/2" deep DOWSIL 995 silicon sealant.

Specimen #01, #02 and #03

LOCATION	QUANTITY	DAYLIGHT OPENING inches	GLASS BITE
Door sash	1	29-1/2 x 86-1/2	9/16"

TEST REPORT

Issue Date: 2026-01-15

Intertek Report No.: 250815008SHF-001

Drainage: *No drainage was utilized*

Hardware: Specimen #01, #02 and #03

DESCRIPTION	QUANTITY	LOCATION	MANUFACTURER	MODEL NUMBER
Handle	2	Door sash	HOPPE	1540/3347N
Hinge	4	Door frame/sash	ROTO	C-H0060-00-0-6
Strike Plate	1	Door frame	ROTO	C-93092-03-0-8
Lock	1	Door sash	ROTO	C-90811-35-0-8
Latch Segment	6	Door frame	ROTO	6-30959-00-0-1
Lock rod	4	Door sash	ROTO	6-24539-00-0-1
Corner Actuator	2	Door sash	ROTO	819870
Lock Point	6	Door sash	ROTO	213700
Lock Cylinder	1	Door sash	ROTO	85TX30

TEST REPORT

Issue Date: 2026-01-15

Intertek Report No.: 250815008SHF-001

SECTION 8

TEST RESULTS

Protocol TAS 202-94, Static Air Pressure

Test Date(s): 11/28/2025 through 11/28/2025

The temperature during testing was 15°C (59.0°F). The results are tabulated as follows:

Test Specimen #01

TITLE OF TEST	RESULTS	ALLOWED	NOTE
Air Leakage Infiltration per TAS 202 at 1.57 psf (25 mph)	0.10 L/s/m ² (0.02 cfm/ft ²)	1.0 L/s/m ² (0.20 cfm/ft ²) max.	1
Air Leakage Infiltration per TAS 202 at 6.24 psf (50 mph)	0.69 L/s/m ² (0.14 cfm/ft ²)	1.5 L/s/m ² (0.30 cfm/ft ²) max.	

Note 1: Test Date 11/28/25 / Time: 9:30 AM (Air Note Only)

Test Specimen #01, #02 and #03: Preload and Design Load per TAS 202

LOAD (psf)	INDICATOR LOCATION	DEFLECTION (in.)		PERMANENT SET (in.)	
		MEASURED	ALLOWED	MEASURED	ALLOWED
+45.0 50% of Test Pressure	2	<0.01	N/A	<0.01	N/A
	5	0.01	N/A	<0.01	N/A
	8	<0.01	N/A	<0.01	N/A
	11	<0.01	N/A	<0.01	N/A
+60.0 Design Pressure	2	<0.01	N/A	<0.01	N/A
	5	<0.01	N/A	<0.01	N/A
	8	<0.01	N/A	<0.01	N/A
	11	<0.01	0.07	<0.01	N/A

Test Specimen #01, #02 and #03: Preload and Design Load per TAS 202

LOAD (psf)	INDICATOR LOCATION	DEFLECTION (in.)		PERMANENT SET (in.)	
		MEASURED	ALLOWED	MEASURED	ALLOWED
-45.0 50% of Test Pressure	2	0.01	N/A	<0.01	N/A
	5	<0.01	N/A	<0.01	N/A
	8	0.01	N/A	0.01	N/A
	11	<0.01	N/A	<0.01	N/A
-60.0 Design Pressure	2	0.01	N/A	<0.01	N/A
	5	<0.01	0.07	<0.01	N/A
	8	0.01	N/A	0.01	N/A
	11	<0.01	0.07	<0.01	N/A

TEST REPORT

Issue Date: 2026-01-15

Intertek Report No.: 250815008SHF-001

Test Specimen #01: Water Penetration per TAS 202

TITLE OF TEST	RESULTS	ALLOWED	NOTE
Water Penetration, per TAS 202 15% of Positive Design Pressure at 430 Pa (9.0 psf)	Pass	No leakage	2

Note 2: Without insect screen.

Test Specimen #01, #02 and #03: Structural Overload Load per TAS 202

LOAD (psf)	INDICATOR LOCATION	DEFLECTION (in.)		PERMANENT SET (in.)	
		MEASURED	ALLOWED	MEASURED	ALLOWED
90.0 Test Pressure	2	0.01	N/A	<0.01	0.09
	5	0.01	N/A	<0.01	0.09
	8	0.01	N/A	<0.01	0.13
	11	<0.01	N/A	<0.01	0.02
-90.0 Test Pressure	2	0.01	N/A	<0.01	0.09
	5	<0.01	N/A	<0.01	0.09
	8	0.02	N/A	<0.01	0.13
	11	<0.01	N/A	<0.01	0.02

Note 3: Positive and negative uniform static load test loads were held for 30 seconds.

Note 4: Tape and film were not used to seal against air leakage during structural testing.

Note 5: See Sketch No.1 for indicator locations. Deflection/permanent set reported is the overall deflection between three points (longest unsupported span) which accounts for support movement.

Test Specimen #01

TITLE OF TEST	RESULTS	ALLOWED	NOTE
Forced Entry Resistance, per AAMA1304	Pass	No entry	-

TEST REPORT

Issue Date: 2026-01-15

Intertek Report No.: 250815008SHF-001

Protocol TAS 201-94, Large Missile Impact Procedures

Test Date(s): 12/01/2025

The temperature during testing was 18°C (64.4°F). The results are tabulated as follows:

Test Specimen #01, #02 and #03

IMPACT #	MISSILE WEIGHT (lbs.)	MISSILE LENGTH (in.)	MISSILE VELOCITY (ft./sec.)
1	9.1	94	49.2
2			49.2
3			50.2
4			49.5
5			49.5
6			49.2

Note 6: See Sketch No.2 for impact locations.

Protocol TAS 203-94, Cyclic Wind Pressure Loading

Test Date(s): 12/01/2025 through 12/02/2025

The temperature during testing was 18°C (64.4°F). The results are tabulated as follows:

Test Specimen #01, #02 and #03: Cyclic Test Spectrum and Average Cycle Time per TAS 203

DESIGN PRESSURE	STAGE			
+60.0 / -60.0 psf	1	2	3	4
POSITIVE PRESSURE RANGE (psf)	12.0 – 30.0	0 – 36.0	30.0 – 48.0	18.0 – 60.0
AVERAGE CYCLE TIME (sec.)	4	4	5	5
NUMBER OF CYCLES	3500	300	600	100
	5	6	7	8
NEGATIVE PRESSURE RANGE (psf)	18.0 – 60.0	30.0 – 48.0	0 – 36.0	12.0 – 30.0
AVERAGE CYCLE TIME (sec.)	5	5	5	5
NUMBER OF CYCLES	50	1050	50	3350

Note 7: Test Specimens #01, #02 and #03 were cycled in a common chamber.

TEST REPORT

Issue Date: 2026-01-15

Intertek Report No.: 250815008SHF-001

SECTION 9 CONCLUSIONS

The large missiles impacted each intended target. Each impact location was carefully inspected. No signs of penetration, rupture, or opening after the large missile impact test were observed; as such, each test specimen satisfies the large missile requirements of TAS 201. Upon completion of testing, specimens tested for TAS 201-94 met the requirements of Section 1626 of the Florida Building Code, Building.

No signs of failure were observed in any area of the test specimen during the TAS 202 testing; as such, the test specimen satisfies the requirements of TAS 202. Upon completion of testing, specimens tested for TAS 202-94 met the requirements of Section 1620 of the Florida Building Code, Building.


No signs of failure were observed in any area of the test specimens during the cyclic load test; as such, the test specimens satisfy the cyclic load requirements of TAS 203. Upon completion of testing, specimens tested for TAS 203-94 met the requirements of Section 1626 of the Florida Building Code, Building.

TEST REPORT

Issue Date: 2026-01-15

Intertek Report No.: 250815008SHF-001

SECTION 10 SKETCH(ES)

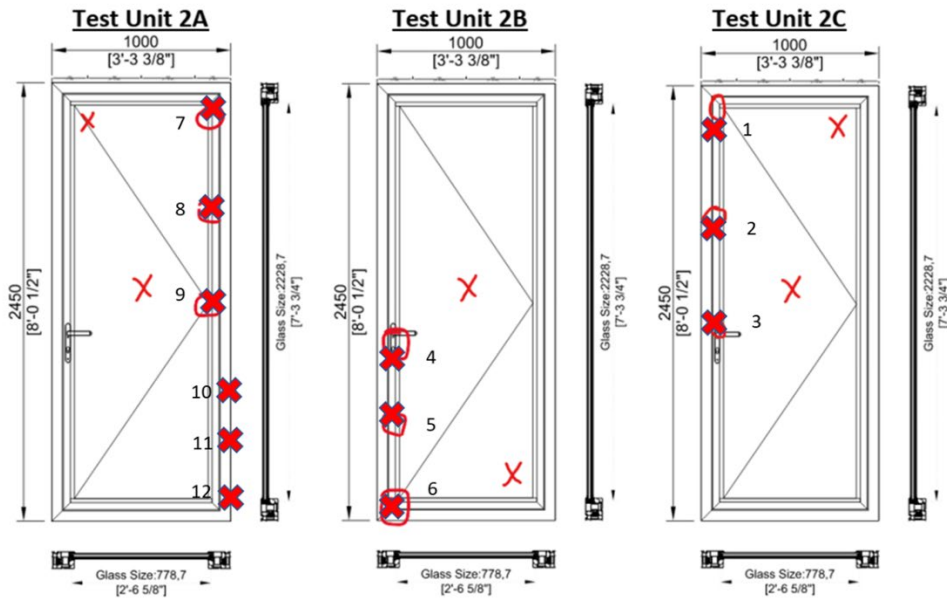


Sketch No. 1

TAS 202 Indicator Locations of specimen #01, #02 and #03

TEST REPORT

Issue Date: 2026-01-15

Intertek Report No.: 250815008SHF-001

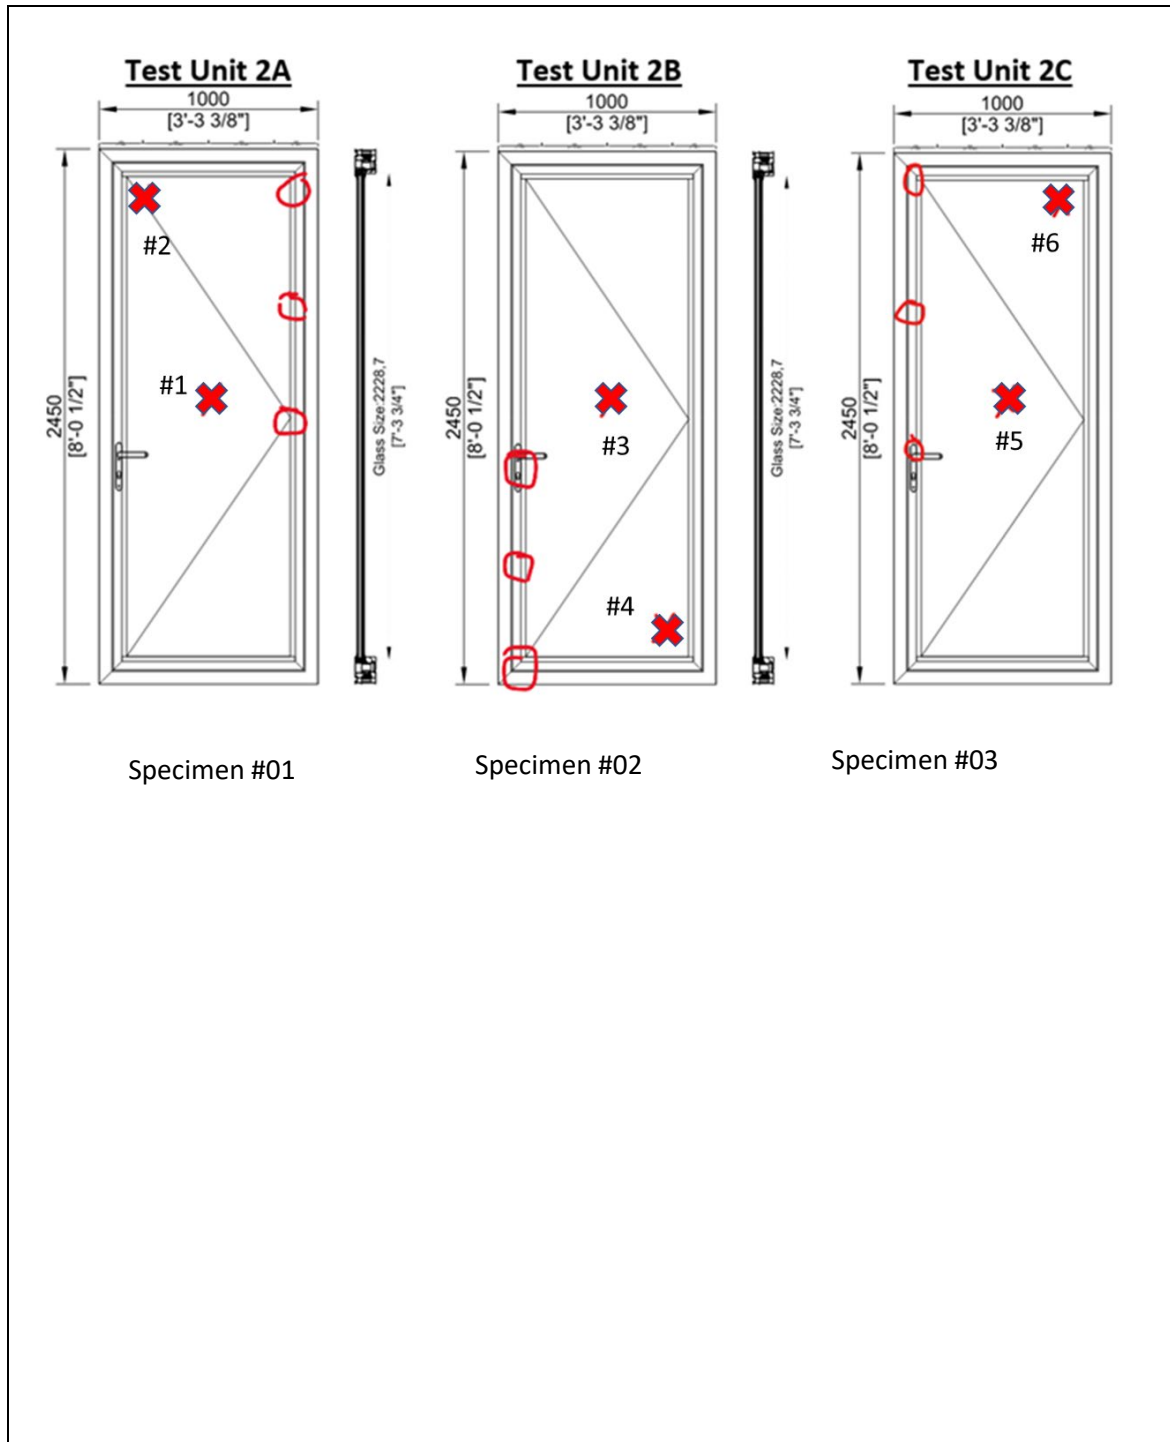

Sketch No.2

TAS 201 Impact Locations of specimen #01, #02 and #03

TEST REPORT

Issue Date: 2026-01-15

Intertek Report No.: 250815008SHF-001

SECTION 11 PHOTOGRAPHS



Photo No. 1
Specimens #01, #02 and #03 before impact test (Testing on December 1, 2025)



Photo No. 2
Specimens #01, #02 and #03 after impact test (Testing on December 1, 2025)

TEST REPORT

Issue Date: 2026-01-15

Intertek Report No.: 250815008SHF-001

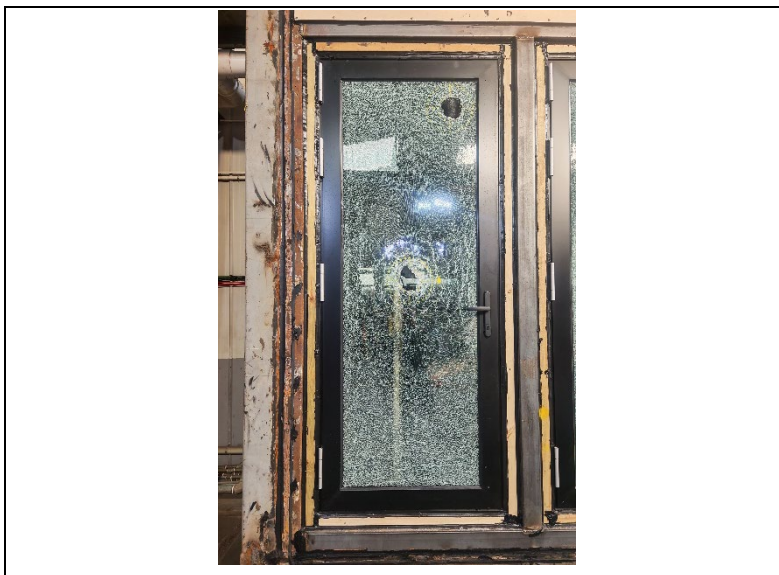


Photo No.3

Specimen #01 after impact test (Testing on December 1, 2025)

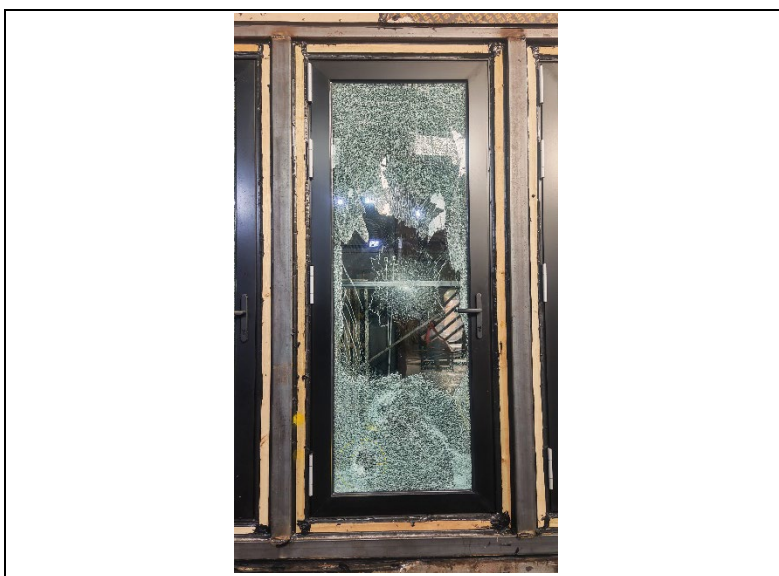


Photo No.4

Specimen #02 after impact test (Testing on December 1, 2025)

TEST REPORT

Issue Date: 2026-01-15

Intertek Report No.: 250815008SHF-001



Photo No.5

Specimen #03 after impact test (Testing on December 1, 2025)



Photo No.6

Specimen #01, #02 and #03 after cyclic test (Testing on December 2, 2025)

TEST REPORT

Issue Date: 2026-01-15

Intertek Report No.: 250815008SHF-001

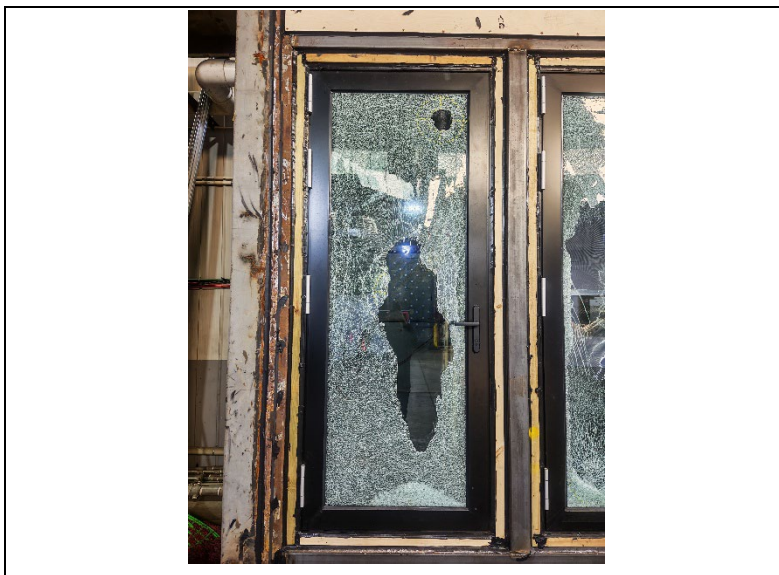


Photo No.7

Specimen #01 after cyclic test (Testing on December 2, 2025)

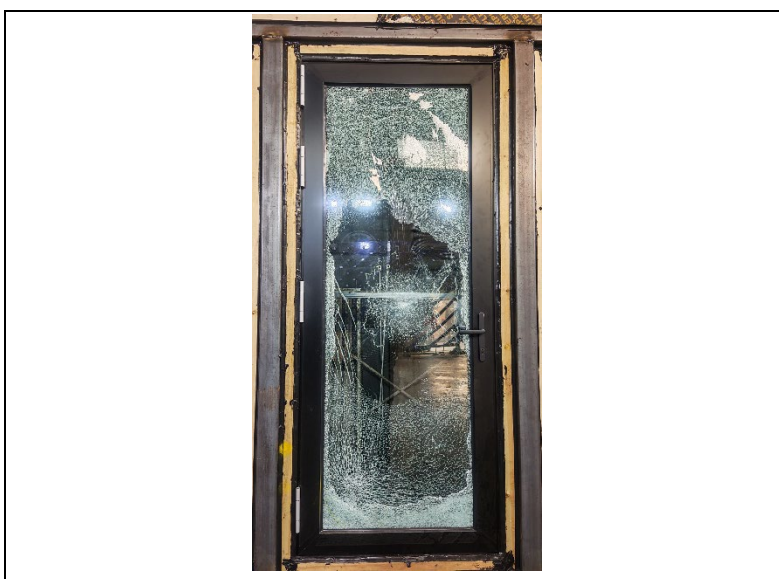


Photo No.8

Specimen #02 after cyclic test (Testing on December 2, 2025)

TEST REPORT

Issue Date: 2026-01-15

Intertek Report No.: 250815008SHF-001

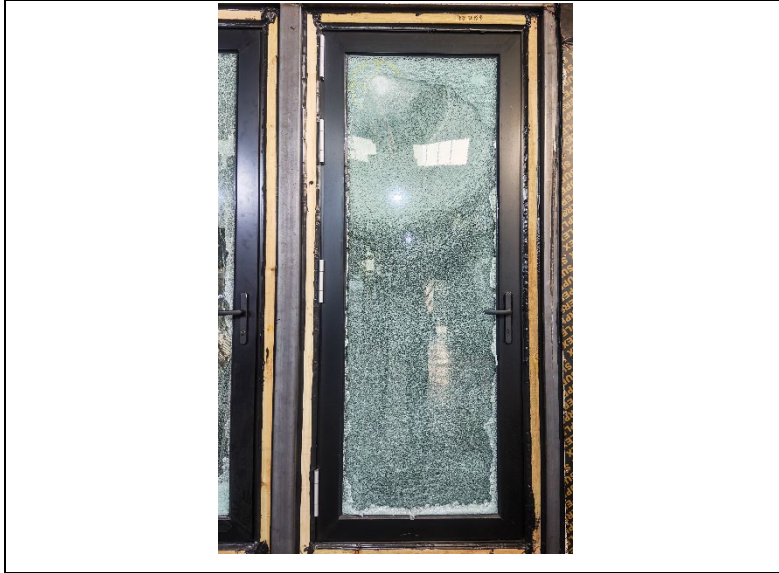


Photo No.9

Specimen #03 after cyclic test (Testing on December 2, 2025)


TEST REPORT

Issue Date: 2026-01-15


Intertek Report No.: 250815008SHF-001

SECTION 12 DRAWINGS

The test specimen drawings have been reviewed by Intertek B&C and are representative of the test specimen(s) reported herein. Test specimen construction was verified by Intertek B&C per the drawings included in this report. Any deviations are documented herein or on the drawings.

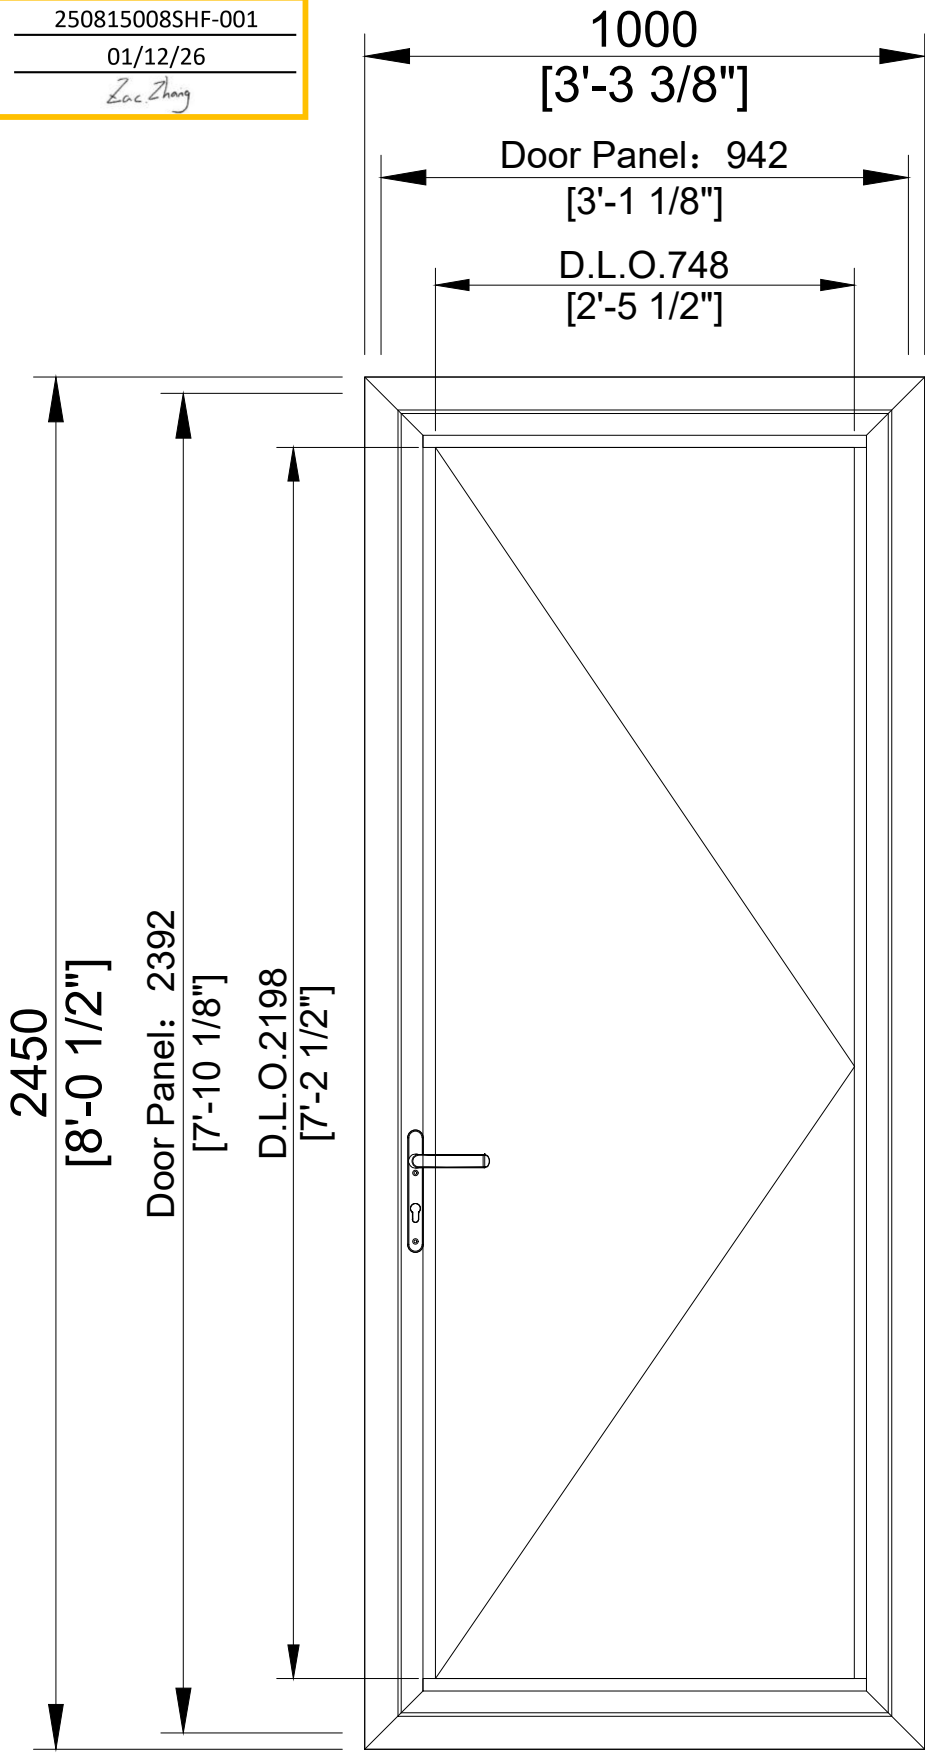

Elevation of door
Interior View

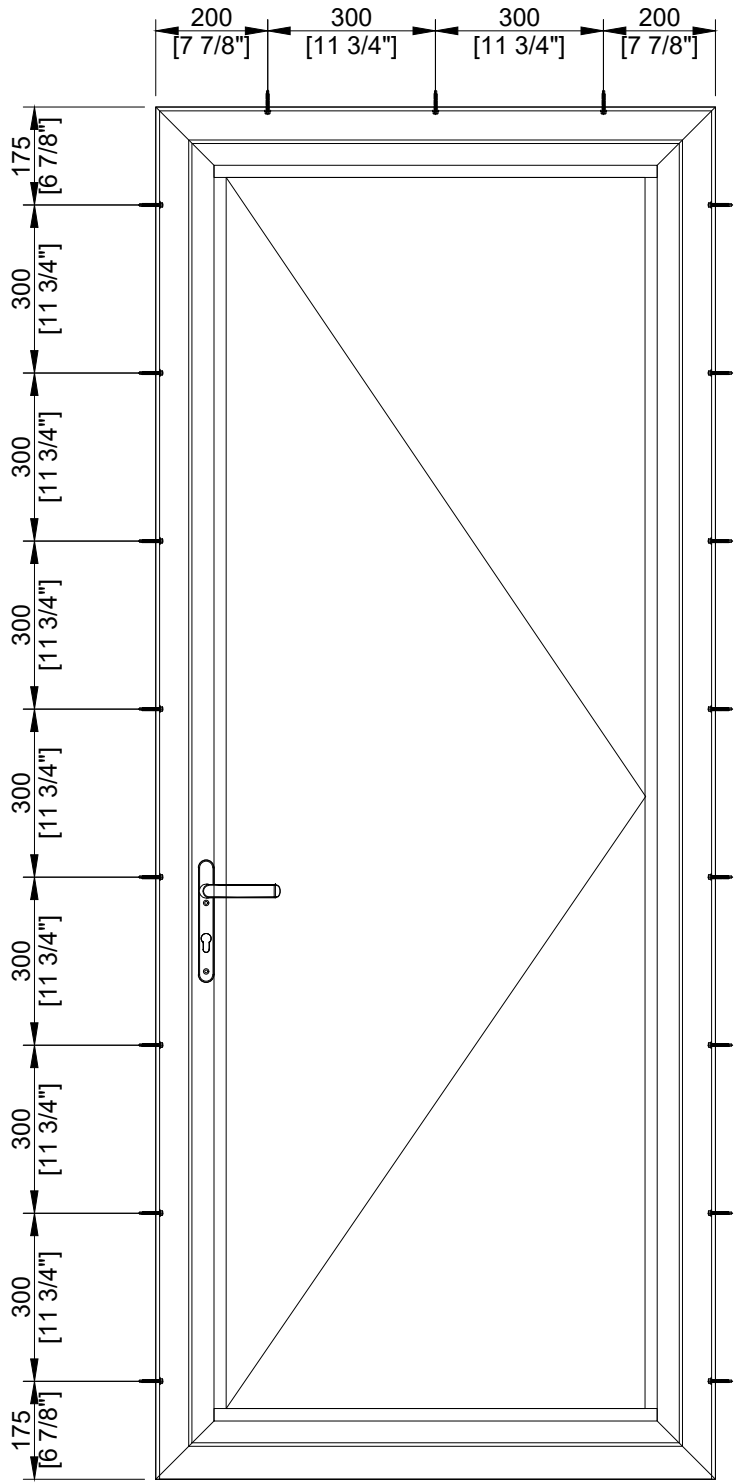

Position of the Anchor Screw

PROJECT/CLIENT :

Shoping Drawing

PROJECT COORDINATOR:

Vincent Hsu

DRAWN BY:

Jason

DATE:

5th Dec 2025

DWG NO:

CJJC-V1

DRAWING NOTES :

Drawing For Production
Interior View

SIZED BY:

Finished Assembled
Dimension

SIGNATURE:

Contact us

Website: www.luvindow.com

WhatsApp: +86 186 0002 6127

+86 139 1172 1486

Email: support@doorwingroup.com

LA Showroom

1550 S Sunkist St Unit A, Anaheim



U.S. Phone:(858)260 9698

Dallas Showroom

6905 K Avenue, Suite 206, Plano,

TX 75074

U.S. Phone:(945)274 4438

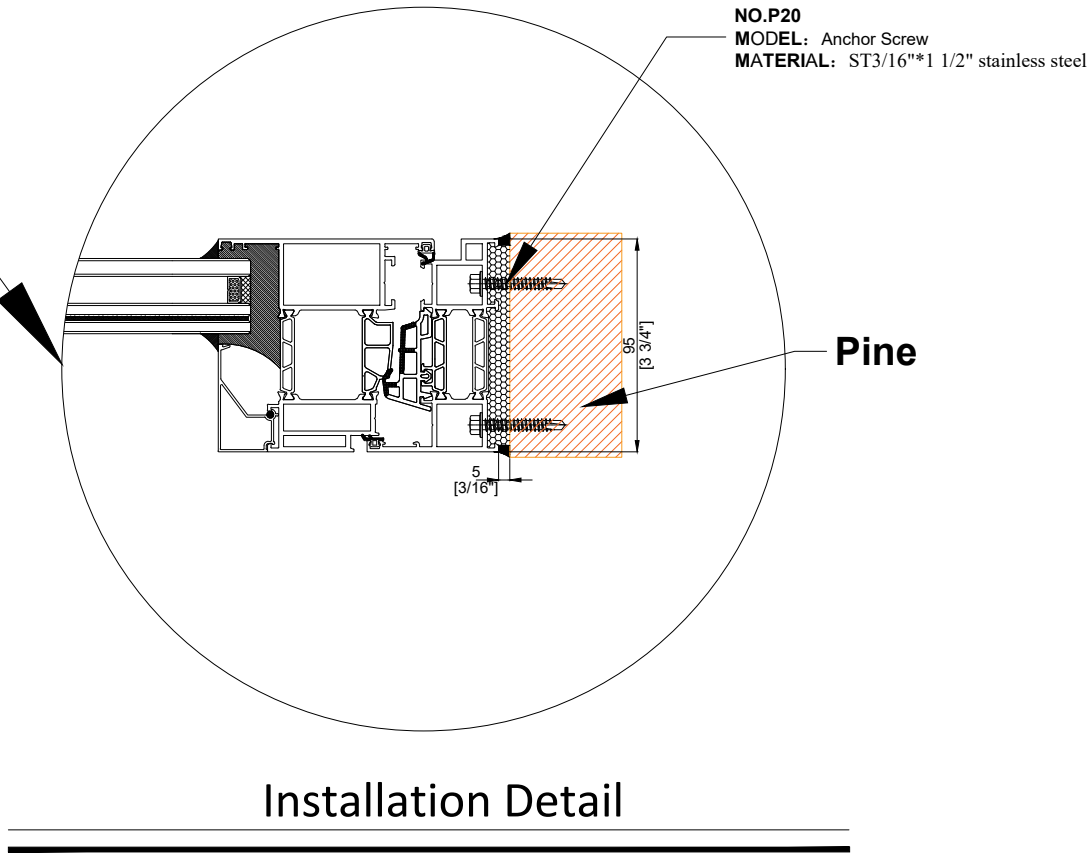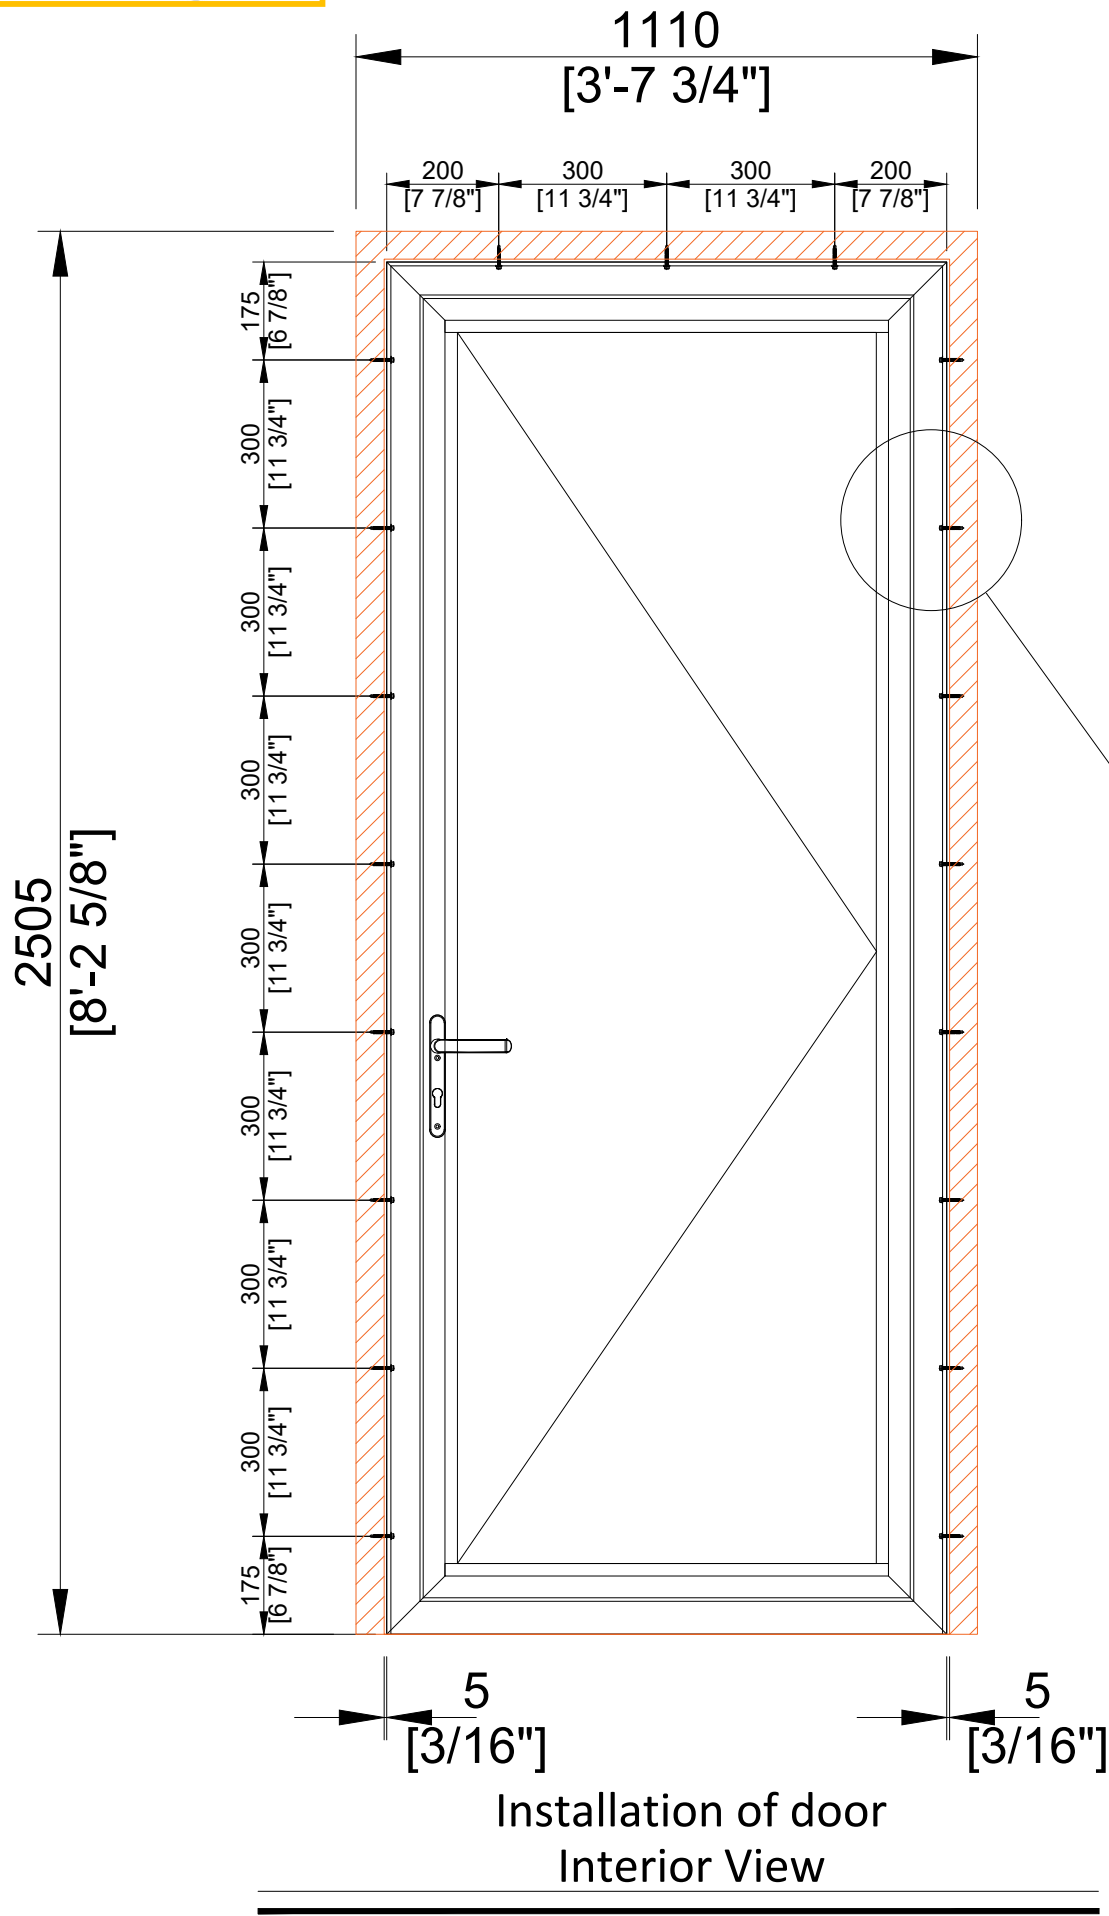

PROJECT/CLIENT :

Shoping Drawing

PROJECT COORDINATOR:

Vincent Hsu

DRAWN BY:

Jason

DATE:

5th Dec 2025

DWG NO:

CJJC-V1

DRAWING NOTES :

Drawing For Production

Interior View

SIZED BY:

Finished Assembled
Dimension

SIGNATURE:

Contact us

Website: www.luvindow.com

WhatsApp: +86 186 0002 6127

+86 139 1172 1486

Email: support@doorwingroup.com

LA Showroom

1550 S Sunkist St Unit A, Anaheim

U.S. Phone:(858)260 9698

Dallas Showroom

6905 K Avenue, Suite 206, Plano,

TX 75074

U.S. Phone:(945)274 4438

PROJECT/CLIENT :

Shoping Drawing

PROJECT COORDINATOR:

Vincent Hsu

DRAWN BY:

Jason

DATE:

5th Dec 2025

DWG NO:

CJJC-V1

DRAWING NOTES :

Drawing For Production

Interior View

SIZED BY:

Finished Assembled
Dimension

SIGNATURE:

Contact us

Website: www.luvindow.com

WhatsApp: +86 186 0002 6127

+86 139 1172 1486

Email: support@doorwingroup.com

LA Showroom

1550 S Sunkist St Unit A, Anaheim


U.S. Phone:(858)260 9698

Dallas Showroom

6905 K Avenue, Suite 206, Plano,

TX 75074

U.S. Phone:(945)274 4438

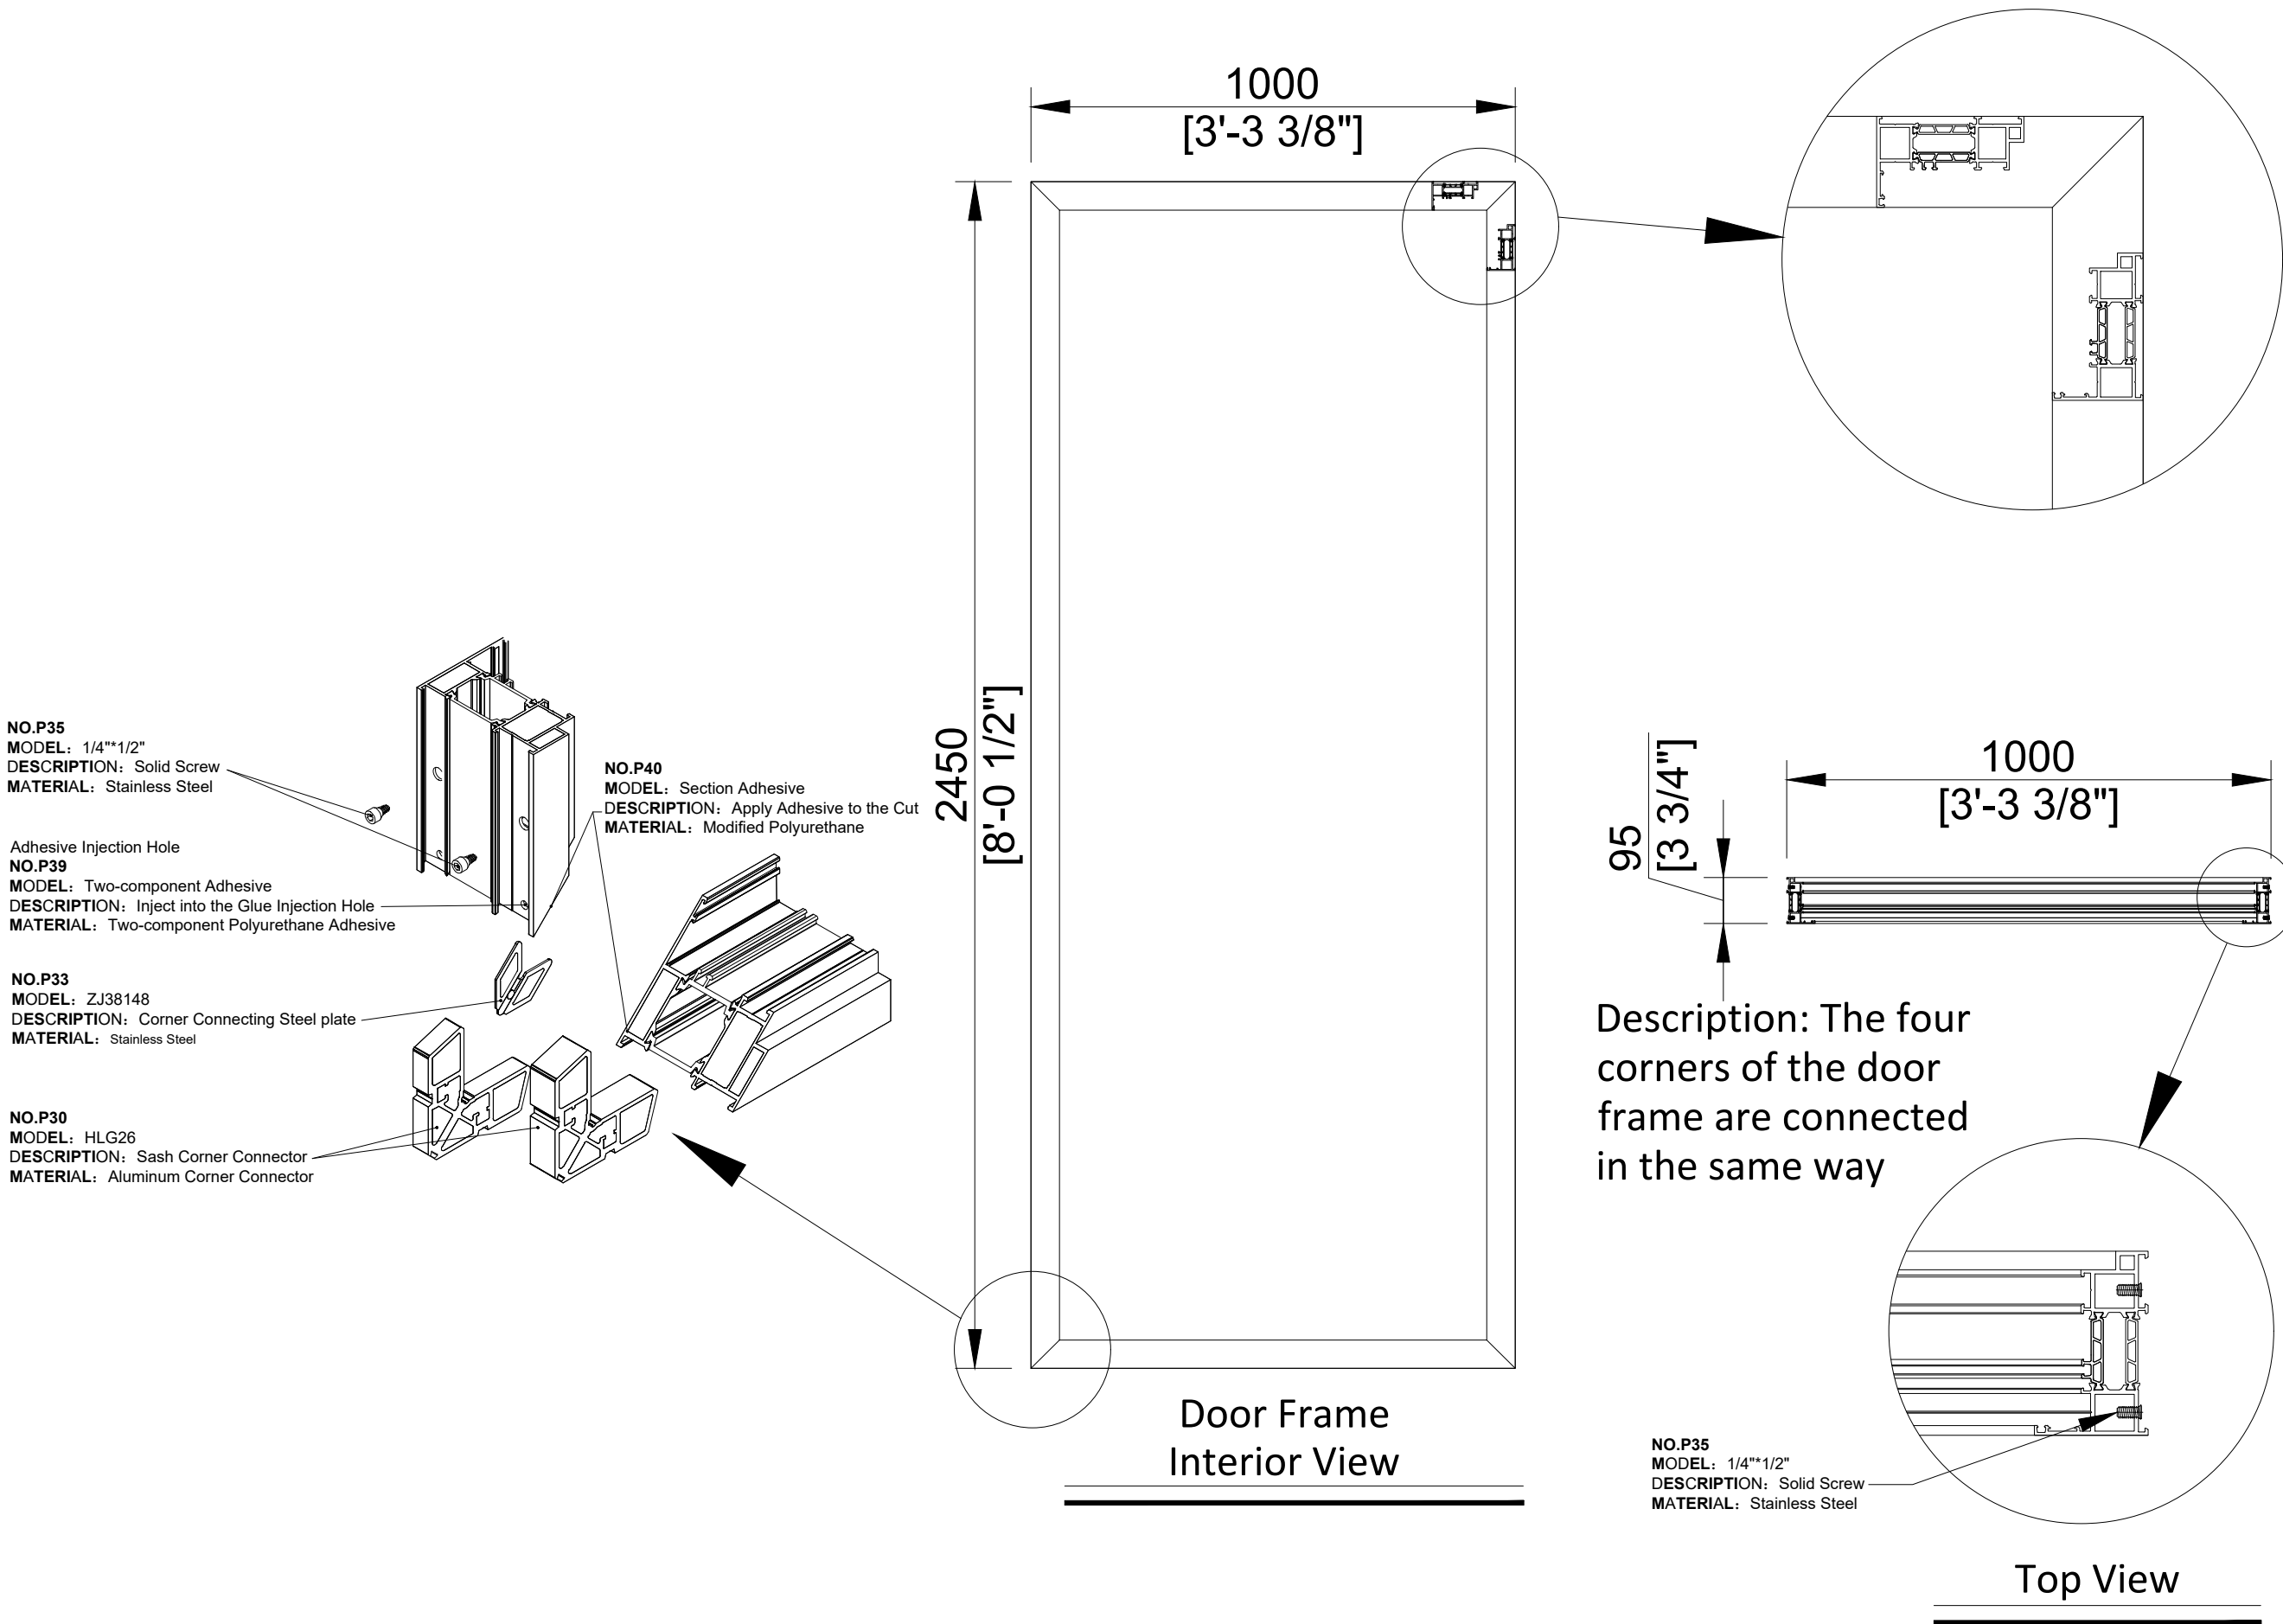

PROJECT/CLIENT :

Shoping Drawing

PROJECT COORDINATOR:

Vincent Hsu

DRAWN BY:

Jason

DATE:

5th Dec 2025

DWG NO:

CJJC-V1

DRAWING NOTES :

Drawing For Production

Interior View

SIZED BY:

Finished Assembled
Dimension

SIGNATURE:

Contact us

Website: www.luvindow.com

WhatsApp: +86 186 0002 6127

+86 139 1172 1486

Email: support@doorwingroup.com

LA Showroom

1550 S Sunkist St Unit A, Anaheim



U.S. Phone:(858)260 9698

Dallas Showroom


6905 K Avenue, Suite 206, Plano,

TX 75074

U.S. Phone:(945)274 4438

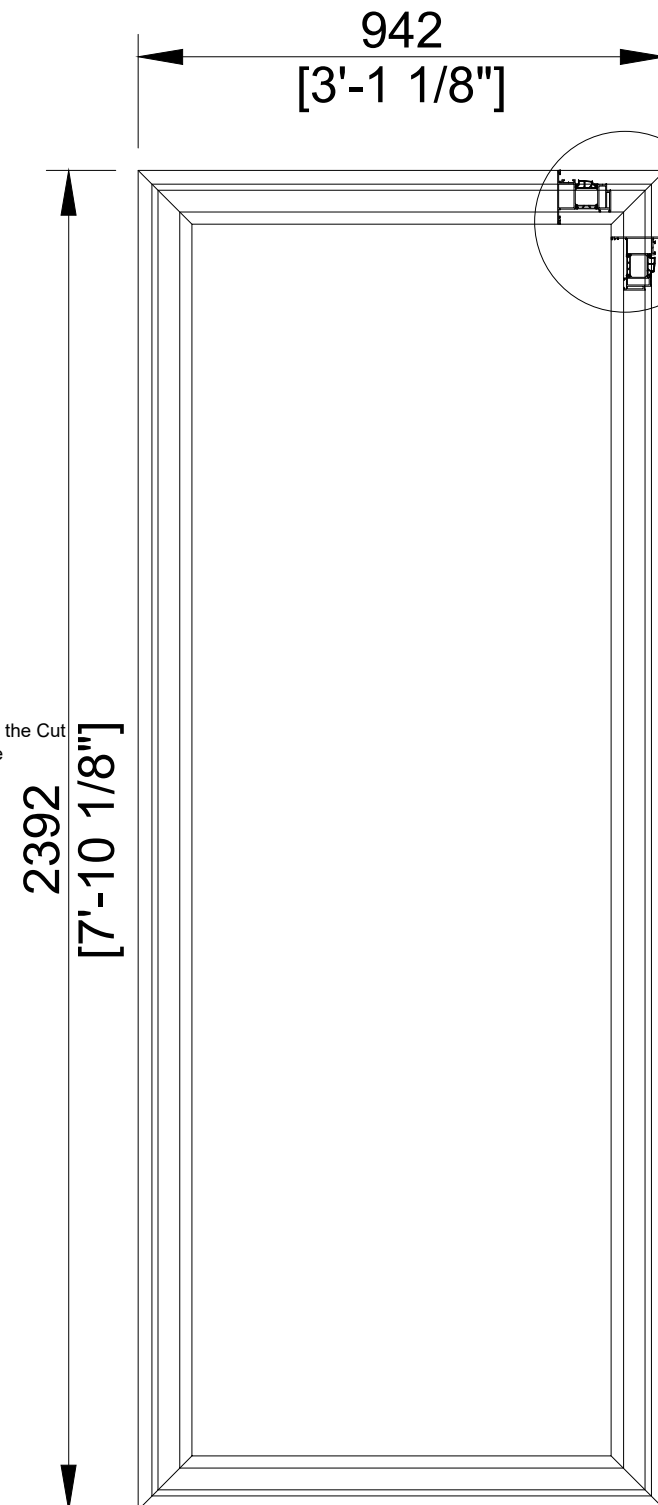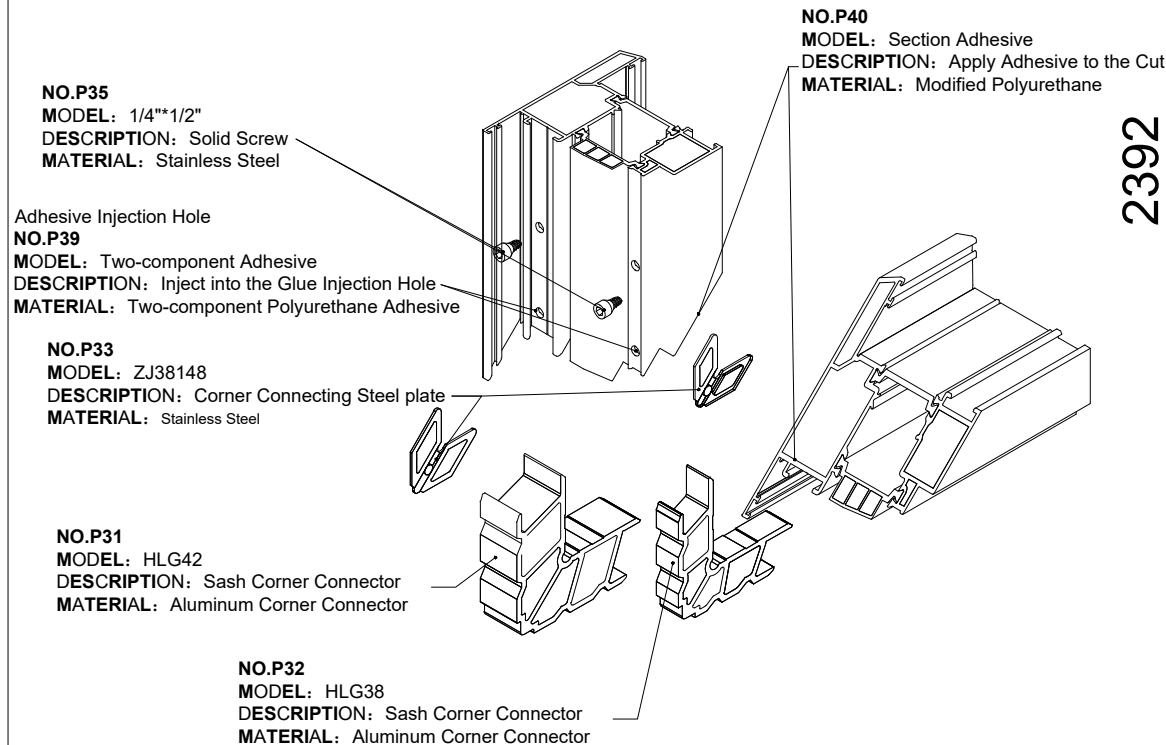


Door Panel
Interior View

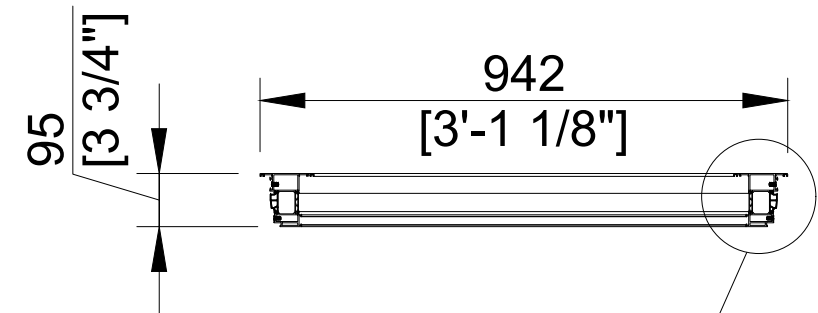


Description: The four
corners of the window
frame are connected
in the same way

NO.P35
MODEL: 1/4**1/2"
DESCRIPTION: Solid Screw
MATERIAL: Stainless Steel

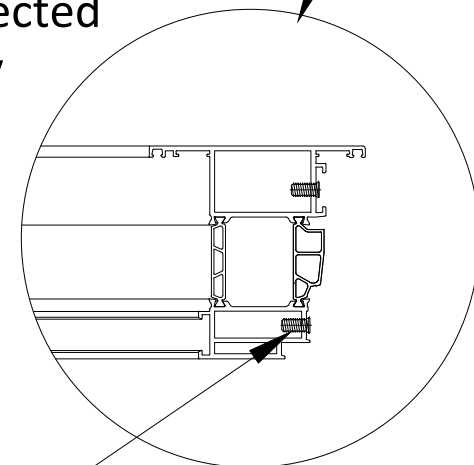

Top View

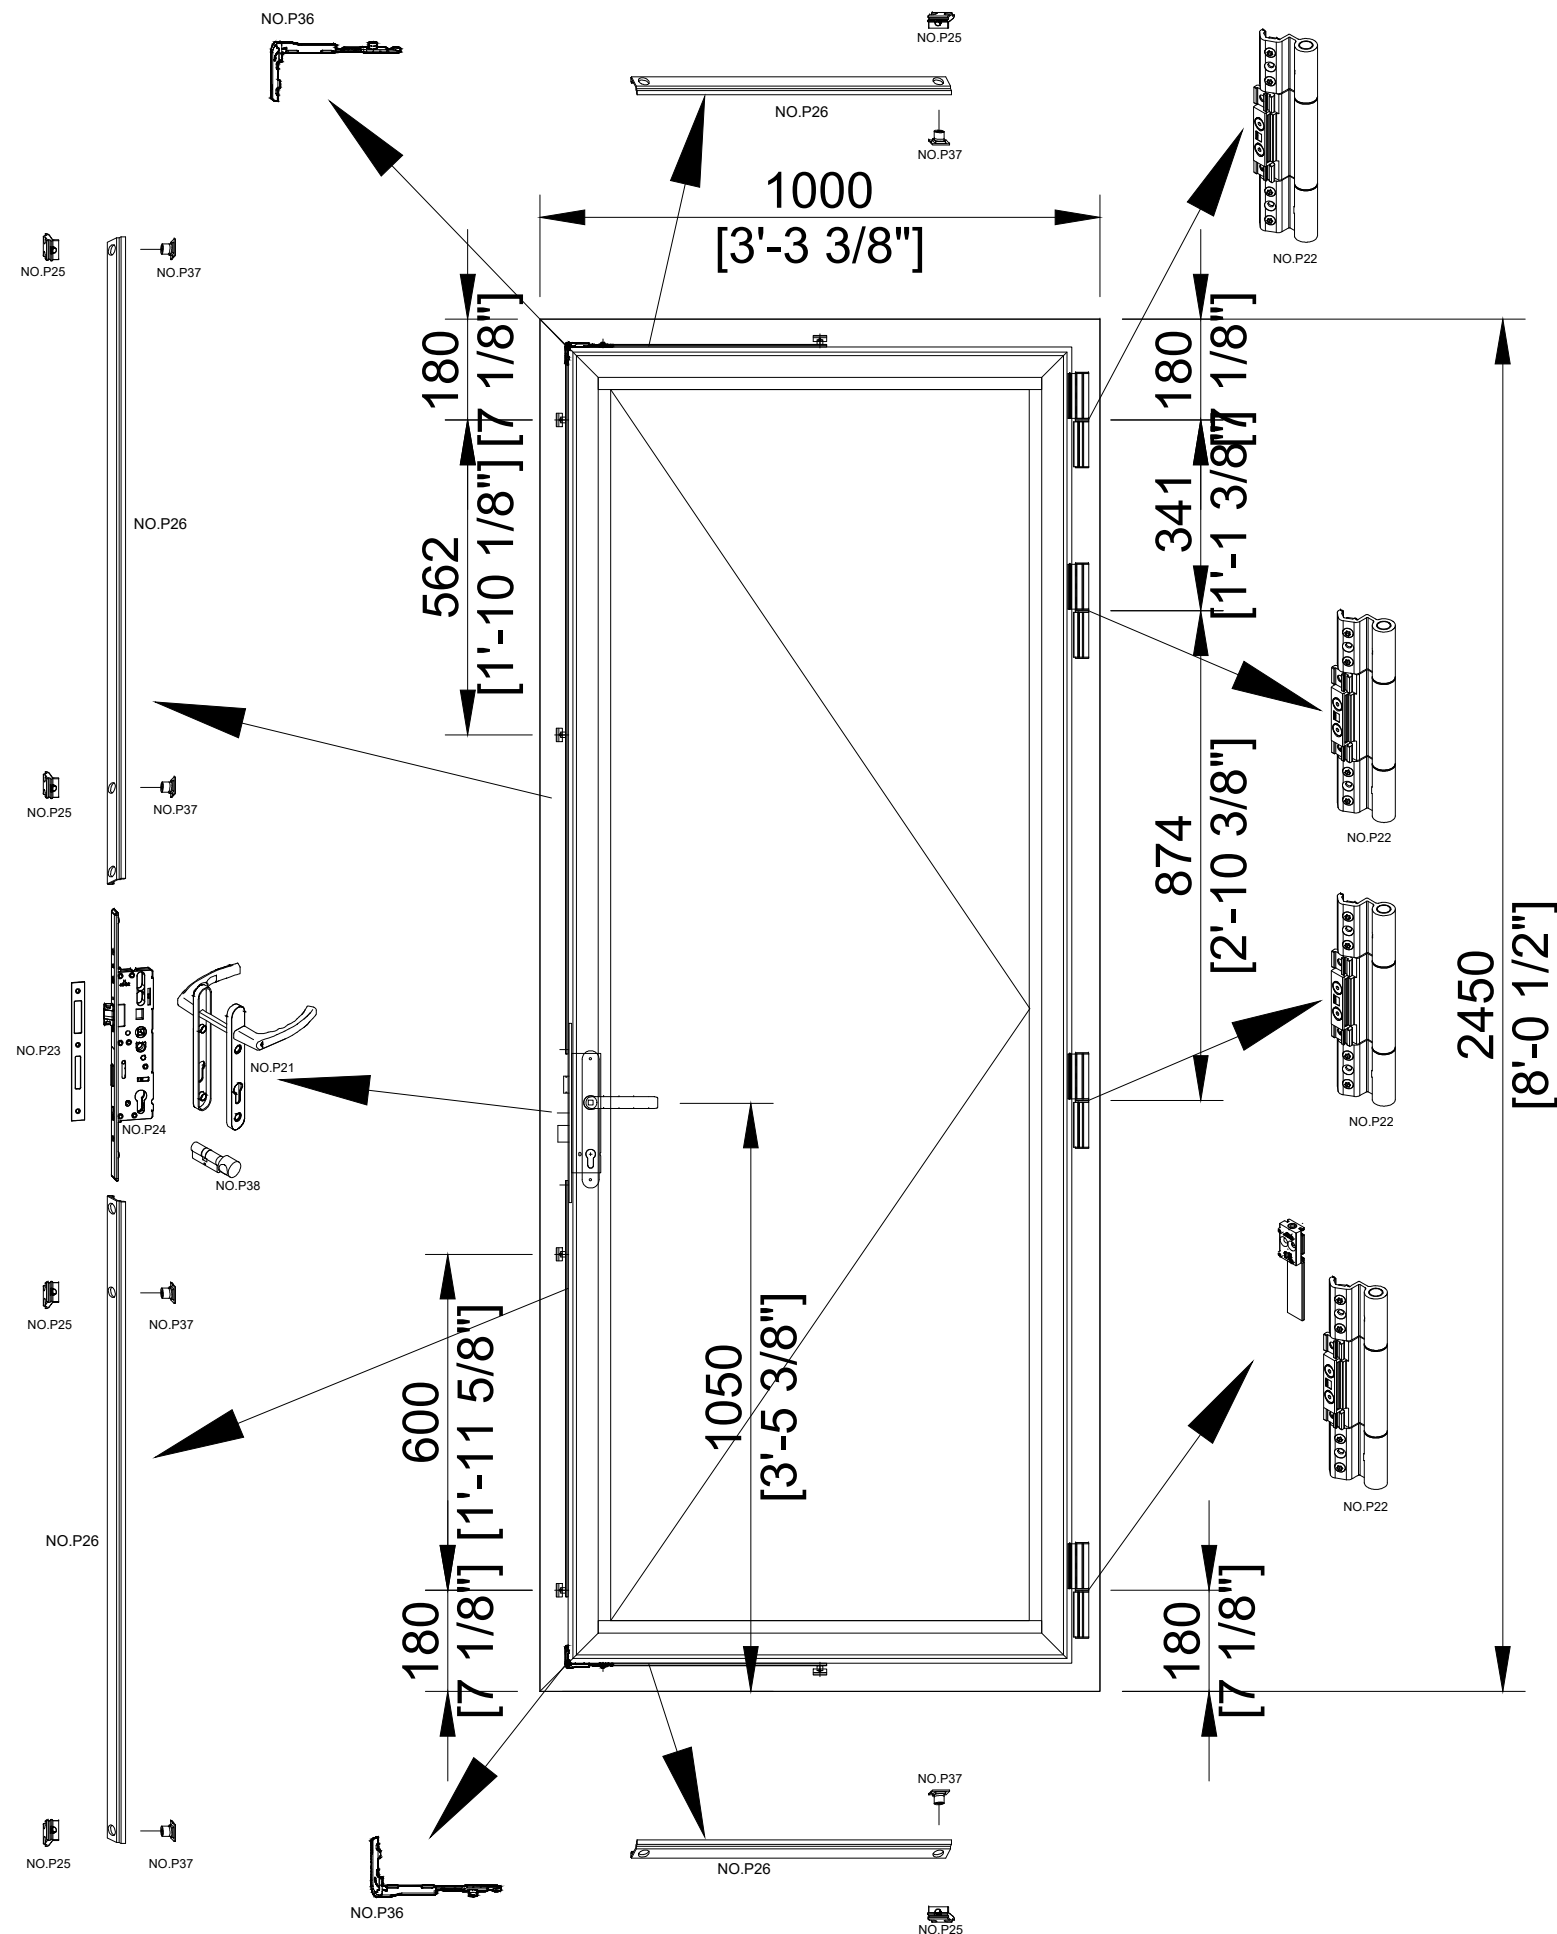

Hardware Distribution of Door

intertek
Total Quality. Assured.

Report #: 250815008SHF-001
Date: 01/12/26
Verified by: *Zac Zhang*

LUVINDOW
EVERY PANE IS A PASSIONATE FRAME

PROJECT/CLIENT :

Shoping Drawing

PROJECT COORDINATOR:

Vincent Hsu

DRAWN BY:

Jason

DATE:

5th Dec 2025

DWG NO:

CJJC-V1

DRAWING NOTES :

Drawing For Production
Interior View

SIZED BY:

Finished Assembled
Dimension

SIGNATURE:

Contact us

Website: www.luvindow.com

WhatsApp: +86 186 0002 6127

+86 139 1172 1486

Email: support@doorwingroup.com

LA Showroom

1550 S Sunkist St Unit A, Anaheim

U.S. Phone:(858)260 9698

Dallas Showroom

6905 K Avenue, Suite 206, Plano,

TX 75074

U.S. Phone:(945)274 4438

PROJECT/CLIENT :

Shoping Drawing

PROJECT COORDINATOR:

Vincent Hsu

DRAWN BY:

Jason

DATE:

5th Dec 2025

DWG NO:

CJJC-V1

DRAWING NOTES :

Drawing For Production

Interior View

SIZED BY:

Finished Assembled
Dimension

SIGNATURE:

Contact us

Website: www.luvindow.com

WhatsApp: +86 186 0002 6127

+86 139 1172 1486

Email: support@doorwingroup.com

LA Showroom

1550 S Sunkist St Unit A, Anaheim


U.S. Phone:(858)260 9698

Dallas Showroom


6905 K Avenue, Suite 206, Plano,

TX 75074

U.S. Phone:(945)274 4438

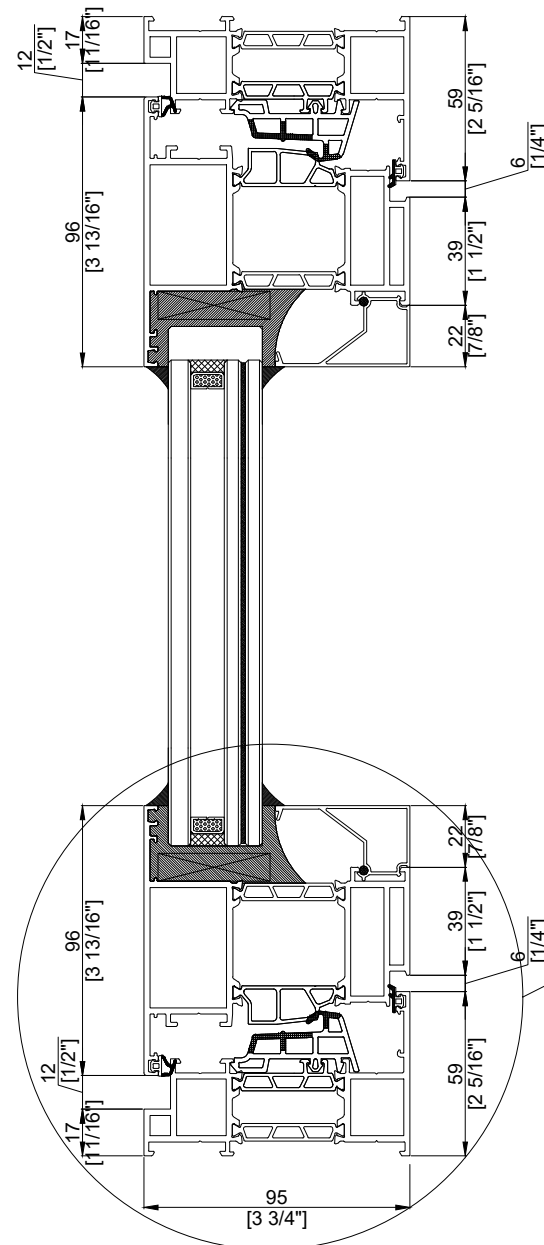

Longitudinal Section

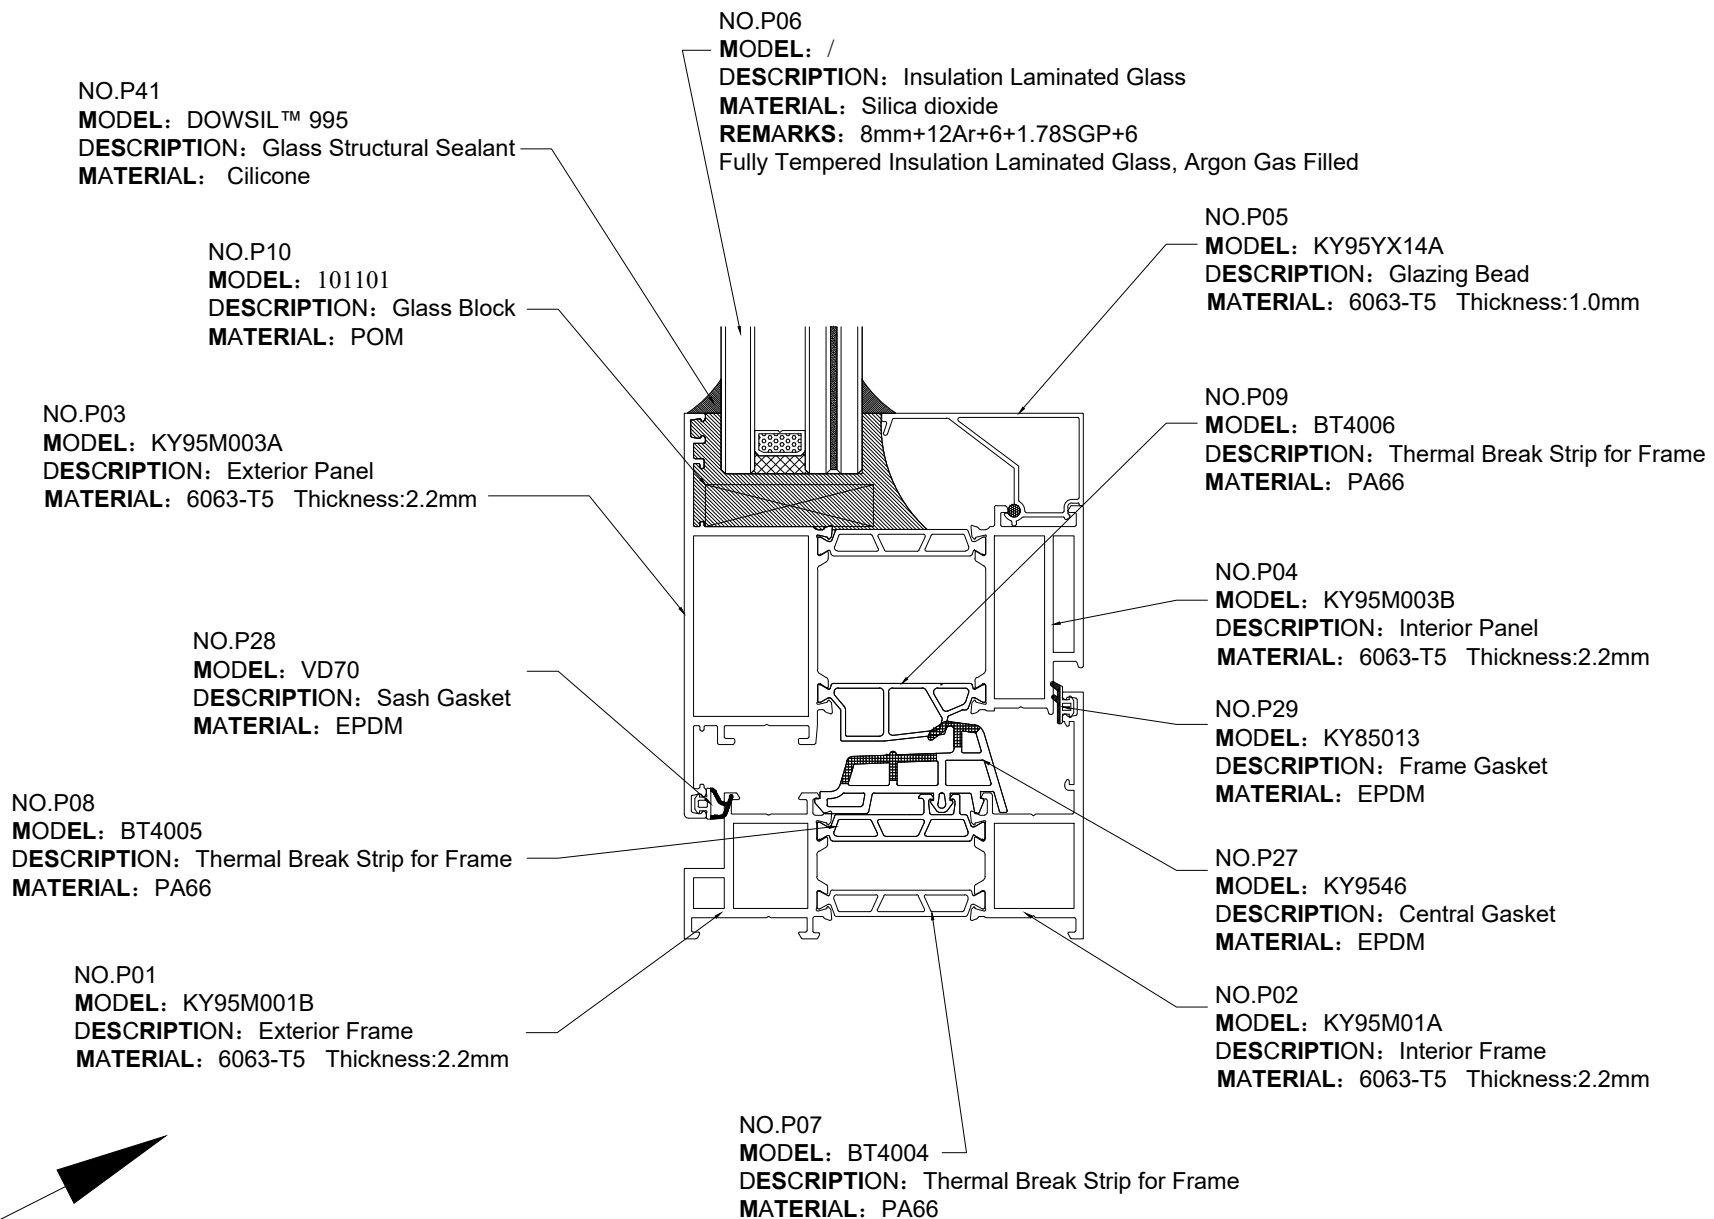

Cross Section

NO.P41
MODEL: DOWSIL™ 995
DESCRIPTION: Glass Structural Sealant
MATERIAL: Cilicone

NO.P10
MODEL: 101101
DESCRIPTION: Glass Block
MATERIAL: POM

NO.P03
MODEL: KY95M003A
DESCRIPTION: Exterior Panel
MATERIAL: 6063-T5 Thickness:2.2mm

NO.P28
MODEL: VD70
DESCRIPTION: Sash Gasket
MATERIAL: EPDM

NO.P08
MODEL: BT4005
DESCRIPTION: Thermal Break Strip for Frame
MATERIAL: PA66

NO.P01
MODEL: KY95M001B
DESCRIPTION: Exterior Frame
MATERIAL: 6063-T5 Thickness:2.2mm

NO.P06
MODEL: /
DESCRIPTION: Insulation Laminated Glass
MATERIAL: Silica dioxide
REMARKS: 8mm+12Ar+6+1.78SGP+6
Fully Tempered Insulation Laminated Glass, Argon Gas Filled

NO.P05
MODEL: KY95YX14A
DESCRIPTION: Glazing Bead
MATERIAL: 6063-T5 Thickness:1.0mm

NO.P09
MODEL: BT4006
DESCRIPTION: Thermal Break Strip for Frame
MATERIAL: PA66


NO.P04
MODEL: KY95M003B
DESCRIPTION: Interior Panel
MATERIAL: 6063-T5 Thickness:2.2mm

NO.P29
MODEL: KY85013
DESCRIPTION: Frame Gasket
MATERIAL: EPDM

NO.P27
MODEL: KY9546
DESCRIPTION: Central Gasket
MATERIAL: EPDM












NO.P02
MODEL: KY95M01A
DESCRIPTION: Interior Frame
MATERIAL: 6063-T5 Thickness:2.2mm










NO.P07
MODEL: BT4004
DESCRIPTION: Thermal Break Strip for Frame
MATERIAL: PA66

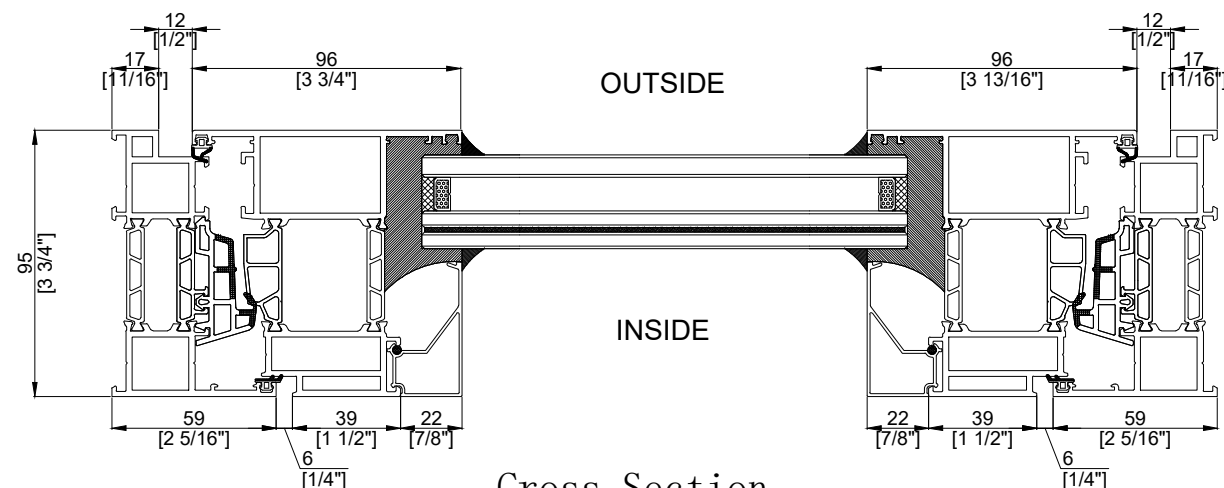

OUTSIDE

INSIDE

No.	Diagram	Name	Descriptions
P01		KY95M001B 框外面 Exterior Frame	6063-T5 铝型材 6063-T5 Extruded Aluminum Profiles
P02		KY95M01A 框内面 Interior Frame	6063-T5 铝型材 6063-T5 Extruded Aluminum Profiles
P03		KY95M003A 扇外面 Exterior Panel	6063-T5 铝型材 6063-T5 Extruded Aluminum Profiles
P04		KY95M003B 扇内面 Interior Panel	6063-T5 铝型材 6063-T5 Extruded Aluminum Profiles
P05		KY95YX14A 扇玻璃压条 Glazing Bead	6063-T5 铝型材 6063-T5 Extruded Aluminum Profiles
P06		玻璃 Glass Unit	8mm+12Ar+6+1.78SGP+6 Fully Tempered Insulation Laminated Glass, Argon Gas Filled
P07		BT4004 框隔热条 Thermal Break Strip for Frame	PA66
P08		BT4005 框隔热条 Thermal Break Strip for Frame	PA66
P09		BT4006 框隔热条 Thermal Break Strip for Frame	PA66
P10		101101玻璃垫块 Glass Block	聚甲醛 POM
P11		031101玻璃垫块 Glass Block	聚甲醛 POM
P20		固定螺丝 Anchor Screw	不锈钢 ST3/16"*1 1/2" stainless steel

No.	Diagram	Name	Descriptions
P21		1540/3347N 好博执手 Handle	成品铝合金执手 Aluminum Handle From Germany HOPPE Handle
P22		C-H0060-00-0-6 柱式合页 Hinge	成品五金 不锈钢+铜合金 Hardware Stainless steel copper alloy
P23		C-93092-03-0-8 锁扣板 Strike Plate	成品五金 不锈钢 Stainless Steel
P24		C-90811-35-0-8 锁体+传动器 Lock+Actuator	成品五金 不锈钢 Stainless Steel
P25		6-30959-00-0-1 锁块 Latch Segment	成品五金 锌合金 Hardware Zinc Alloy
P26		6-24539-00-0-1 锁杆 Lock rod	成品五金 锌合金 Hardware Zinc Alloy
P27		KY9546 等压胶条 Central Gasket	三元乙丙 EPDM
P28		VD70 扇内胶条 Interior Sash Gasket	三元乙丙 EPDM
P29		KY85013 框胶条	三元乙丙 EPDM
P30		HLG26 框角码 Sash Corner Connector	一体角码 Aluminum Corner Connector
P31		HLG42 扇角码 Sash Corner Connector	一体角码 Aluminum Corner Connector
P32		HLG38 扇角码 Sash Corner Connector	一体角码 Aluminum Corner Connector
P33		ZI38148 组角钢片 Corner Connecting Steel plate	不锈钢 Stainless Steel
P35		实心螺丝 Solid Screw	不锈钢 Stainless Steel 1/4"*1/2"
P36		819870 转角器 Angle Adjuster	成品五金 锌合金 Hardware Zinc Alloy
P37		213700 锁点 Lock Point	成品五金 锌合金 Hardware Zinc Alloy
P38		锁芯 Lock Cylinder	不锈钢 Stainless Steel
P39		双组份胶 Two-component Adhesive	比利时速的澳 Belgium Soudal
P40		断面胶 Section Adhesive	北京圣威斯科技有限公司 Beijing Shengweisi Technology Co., Ltd.
P41		玻璃结构胶 Glass Structural Sealant	硅酮 Cilicone

PROJECT/CLIENT :

Shoping Drawing

PROJECT COORDINATOR:

Vincent Hsu

DRAWN BY:

Jason

DATE:

5th Dec 2025

DWG NO:

CJJC-V1

DRAWING NOTES :

Drawing For Production

Interior View

SIZED BY:

Finished Assembled
Dimension

SIGNATURE:

Contact us

Website: www.luvindow.com

WhatsApp: +86 186 0002 6127

+86 139 1172 1486

Email: support@doorwingroup.com

LA Showroom

1550 S Sunkist St Unit A, Anaheim

U.S. Phone:(858)260 9698

Dallas Showroom

6905 K Avenue, Suite 206, Plano,

TX 75074

U.S. Phone:(945)274 4438

TEST REPORT

Issue Date: 2026-01-15

Intertek Report No.: 250815008SHF-001

SECTION 13

REVISION LOG

REVISION #	DATE	PAGES	REVISION
0	2026-01-12	N/A	Original Report Issue